

.....


The Village of Dansville

Water Department 2024 Annual Statement

.....



*Providing Quality Water
to Home and Industry*

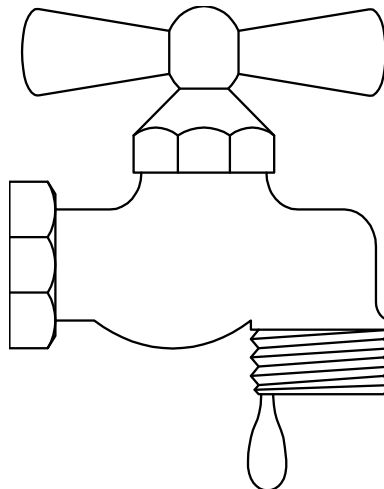

Annual Drinking Water Quality Report for 2024
Village of Dansville Water System
9990 Highland Ave. Dansville, NY 14437
(Public Water Supply ID# NY2501015)

INTRODUCTION

To comply with State regulations, The Village of Dansville Water System will be annually issuing a report describing the quality of your drinking water. The purpose of this report is to raise your understanding of drinking water and awareness of the need to protect our drinking water sources. Last year, your tap water met all State drinking water health standards. We are proud to report that our system did not violate a maximum contaminant level or any other water quality standard. This report provides an overview of last year's water quality. Included are details about where your water comes from, what it contains, and how it compares to State standards.

If you have any questions about this report or concerning your drinking water, please contact **Matt Williams**, Operator in Charge at 585-335-5330 or 585-335-5270. We want you to be informed about your drinking water. If you want to learn more, please attend any of our regularly scheduled village board meetings. The meetings are held the third Tuesday of each month, 6:00 pm at the North Dansville Town Hall.

WHERE DOES OUR WATER COME FROM?

In general, the sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activities. Contaminants that may be present in source water include: microbial contaminants, inorganic contaminants, pesticides and herbicides, organic chemical contaminants, and radioactive contaminants. In order to ensure that tap water is safe to drink, the State and the EPA prescribe regulations which limit the number of certain contaminants in water provided by public water systems. The State Health Department and the FDA regulations establish limits for contaminants in bottled water which must provide the same protection for public health.

Source of Water: The Village of Dansville obtains its water from two sources, **a surface supply** and **a backup well site** with two wells.

Water Impoundment Reservoir: The Village maintains a 15-acre impoundment reservoir on Reservoir Road in the Town of Wayland. This impoundment contains a cement core earth dam located on Little Mill Creek. An emergency response plan is on file in the Mayor's office.

Mill Creek Supply: Currently, the primary source of raw water for the Village is the Little Mill Creek, which is located southeast of the Village. An impounding reservoir approximately 15 acres in area is located three miles east of the Village on Reservoir Road in the Town of Wayland. The outflow from this reservoir flows into Little Mill Creek, to the surface water intake located on the creek approximately two miles southwest of the impounding reservoir and approximately two miles southeast of the Village. The water is diverted to the intake by a small concrete dam, which creates a shallow impoundment. Two sets of manually cleaned screens remove large materials from the water, which then enters a 12-inch transmission main. The water is conveyed by gravity flow to the existing treatment facility.

While the Mill Creek supply is currently the main source of water for the Village of Dansville, two Perkinsville wells are used to supplement our water supply when the quality of the creek water drops below our filtration facility's ability to treat it. (I.e. during storm runoff periods).

Perkinsville Well Supply: The Village well site is located off County Route 91 in the Town of Wayland in Steuben County just north of the Hamlet of Perkinsville. There are two wells at the site, both of which were installed in 1964. The water is conveyed to the treatment site by a 12-inch water main that runs west from the well site to an abandoned railroad right of way then north to the treatment site.

During 2024, our system did not experience any restriction of our water source.

Water Treatment: The Dansville Water Treatment Plant is located at 9990 Highland Ave. The water filtration facility was constructed in 2001 and has supplied treated water to the Village of Dansville ever since. Prior to distribution, the water is treated using coagulation and filtration, liquid chlorination, fluoridation, and a sequestering agent for lead and copper corrosion control.

Executive Summary of the Village of Dansville Source Water Susceptibility Assessment

The NYSDOH has evaluated this Public Water System’s susceptibility to contamination under the Source Water Assessment Program (SWAP), and their findings are summarized in the paragraphs below. It is important to stress that these assessments were created using available information and only estimate the potential for source water contamination. Elevated susceptibility ratings do not mean that source water contamination has or will occur for this PWS. This PWS provides treatment and regular monitoring to ensure the water delivered to consumers meets all applicable standards.

The assessment area for this drinking water source contains no discrete Potential Contaminant Sources (PCS), but agricultural land in the watershed for this drinking water source poses a variety of risks to drinking water quality. The greatest risks are associated with microbial contaminants, followed by pesticides, phosphorus, and Disinfection-Byproduct (DBP) precursors.

The Livingston County Department of Health and the NYSDOH will use this information to assist in the direction of future source water protection activities. These may include additional water quality monitoring, resource management, planning, and education programs. A copy of this assessment, including a map of the assessment area, can be obtained by contacting us, as noted below.

FACTS AND FIGURES

People Served: The Village of Dansville supplies water to 2,626 total service connections. Village customers account for 2,323 service connections and a population of 4,581. The Town of North Dansville accounts for 281 service connections with a population of 824. 22 service connections are located in the Town of West Sparta. The village also sells bulk water at our highway garage located on Mill Street.

The total water produced in 2024 was 175,721,000 gallons. The daily average of treated water supplied to the distribution system was 481,427 gallons per day. Our highest single day production was 808,000 gallons on 10/04/24. The Village pumped 620,000 gallons from the Perkinsville well source. The wells accounted for 0.35% of the total raw water intake for 2024. The amount of water delivered to customers was 117,052,437. There was an unaccounted-for total of 58,668,563 gallons. This accounts for 33.39% of the total amount produced. This water was used to flush mains, fight fires, leakage, and fire training.

In 2024, water customers were charged as follows:

Effective Water & Sewer Rates 202			
BASE CHARGES			
	Water	Sewer	Total
Village	83.00	83.00	166.00
Outside Village	98.00	98.00	196.00
USAGE RATES PER 1000 GALLONS			
	Water	Sewer	Total
Village	3.50	3.50	7.00
Outside Village	4.00	4.00	8.00
Bulk Water Salesman	\$0.25/50 gal	N/A	
Please note, all base water charges include a capital improvement charge of \$38.53 associated with the construction of the water treatment plant.			

ARE THERE CONTAMINANTS IN OUR DRINKING WATER?

As the State regulations require, we routinely test your drinking water for numerous contaminants. These contaminants include: asbestos, total coliform, turbidity, inorganic compounds, nitrate, lead and copper, volatile organic compounds, radiological contaminants, Total Trihalomethanes (TTHM), Haloacetic Acids (HAA) and synthetic organic compounds. The table presented below depicts which compounds were detected in your drinking water. The State allows us to test for some contaminants less than once per year because the concentrations of these contaminants do not change frequently. Some of our data, though representative, are more than one year old.

It should be noted that all drinking water, including bottled drinking water, might be reasonably expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the EPA's Safe Drinking Water Hotline (800-426-4791) or the Department of Health at 585-243-7280.

Table of Contaminants							
Contaminant	Violation Yes/No	Date of Sample	Level Detected Avg./Max. (Range)	Unit Measurement	MCLG	Regulatory Limit (MRDL, MCL, TT or AL)	Likely Source of Contamination
Disinfectant: Chlorine Residuals Measured in Distribution:							
Chlorine Residual	No	Monthly	Range (0.74-1.23)	mg/l	N/A	MRDL=4 mg/L	Water additive used to control microbes
Microbiological Contaminants/Turbidity							
Turbidity ¹	No	Daily	0.09 (Max) (0.01-0.09)	NTU	N/A	1 NTU (TT)	Soil Runoff
Turbidity ¹	No	Daily	100% ≤ 0.09	NTU	N/A	95% of samples < 0.3 NTU (TT)	Soil Runoff
Turbidity ¹ Distribution	No	5 Per Week	0.18 (Max) (.04-0.18)	NTU	N/A	5 NTU	Pipe corrosion
Inorganic Contaminants							
Barium	No	3/5/24	0.027	mg/L	2	MCL=2	Discharge of drilling wastes; discharge from metal refineries; erosion of natural deposits
Chloride	No	3/5/24	31	mg/L	N/A	MCL=250	Naturally occurring or indicative of road salt contamination.
Fluoride	No	3/5/24	0.51	mg/L	N/A	MCL=2.2	Erosion of natural deposits. Water additive that promotes strong teeth. Discharge from fertilizer and aluminum factories.
Nitrate	No	3/5/24	1.7	mg/L	10	MCL=10	Runoff from fertilizer use; leaching from septic tanks; sewage; erosion of natural deposits
Nickel	No	3/5/24	0.0010	mg/L	N/A	N/A	Nickel enters groundwater and surface water by dissolution of rocks and soils, from atmospheric fallout, biological decays and waste disposal.
Sodium	No	3/5/24	16	mg/L	N/A	N/A	Naturally occurring; road salt; water softeners; animal waste.
Lead and Copper							
Lead	No	7/2023	1.6 ² (ND-8.1 ³)	ug/L	0	15 (AL)	Corrosion of household plumbing systems.
Copper	No	7/2023	0.083 ² (0.0046-0.17 ³)	mg/L	0	1.3 (AL)	Corrosion of household plumbing systems.
Disinfection Byproducts							
Site 1, Bus Garage							
Total Trihalomethanes (TTHMs)	No	Samples collected quarterly	24-59 40.28 ⁴	ug/L	N/A	MCL=80	By-product of drinking water chlorination needed to kill harmful organisms. THMs are formed when source water contains large amounts of organic matter.

Table of Contaminants							
Contaminant	Violation Yes/No	Date of Sample	Level Detected Avg./Max. (Range)	Unit Measurement	MCLG	Regulatory Limit (MRDL, MCL, TT or AL)	Likely Source of Contamination
Haloacetic Acids (HAA)	No	Samples collected quarterly	13-31 26.0 ⁴	ug/L	N/A	MCL=60	By-product of drinking water chlorination.
Site 2, Town Hall							
Total Tri-halomethanes (TTHMs)	No	Samples collected quarterly	17-59 35.63 ⁴	ug/L	N/A	MCL=80	By-product of drinking water chlorination needed to kill harmful organisms. TTHMs are formed when source water contains large amounts of organic matter.
Haloacetic Acids (HAA)	No	Samples collected quarterly	15.9- 28 20.5 ⁴	ug/L	N/A	MCL=60	By-product of drinking water chlorination.

Notes:

1 – Turbidity is a measure of the cloudiness of the water. We test it because it is a good indicator of the effectiveness of our filtration system. Our highest single turbidity measurement for the year occurred on 08/10/24 (0.09 NTU). State regulations require that turbidity must not exceed 1 NTU and that 95% of the turbidity samples collected must measure less than or equal to 0.3 NTU. Five distribution turbidity samples are required at five different locations each week. Turbidity values in the distribution system may not exceed 5 NTU.

2 – The level presented represents the 90th percentile of the 20 sites tested for lead and copper. A percentile is a value on a scale of 100 that indicates the percent of a distribution that is equal to or below it. The 90th percentile is equal to or greater than 90% of the lead and copper values detected at your water system. The action levels for lead and copper were not exceeded in any of the samples collected.

3 – The level presented represents the range of the 20 samples.

4 – The water sample was collected and analyzed each quarter. The level presented is the highest locational running annual average of the samples collected.

Definitions:

Maximum Contaminant Level (MCL): The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible.

Maximum Contaminant Level Goal (MCLG): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum Residual Disinfectant Level (MRDL): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Action Level (AL): The concentration of a contaminant, which, if exceeded, triggers treatment or other requirements, which a water system must follow.

Treatment Technique (TT): A required process intended to reduce the level of a contaminant in drinking water.

Non-Applicable (N/A): The information does not apply to this contaminant.

Non-Detect (ND): Laboratory analysis indicates the constituent is not present (Not detected).

Nephelometric Turbidity Unit (NTU): A measure of the clarity of water. Turbidity in excess of 5 NTU is just noticeable to the average person.

Milligrams per liter (mg/l): Corresponds to one part of liquid in one million parts of liquid (parts per million - ppm).

Micrograms per liter (ug/l): Corresponds to one part of liquid in one billion parts of liquid (parts per billion - ppb).

Haloacetic acids (five) (HAAs): means the sum of the concentrations in milligrams per liter of five specific haloacetic acid compounds.

Total Trihalomethane (TTHM): means the sum of the concentration of trichloromethane (chloroform), dibromochloromethane, bromodichloromethane and tribromomethane (bromoform)

INFORMATION ON FLUORIDE ADDITION

Our system is one of the many drinking water systems in New York State that provides drinking water with a controlled, low level of fluoride for consumer dental health protection. According to the United States Centers for Disease Control, fluoride is very effective in preventing cavities when present in drinking water at a properly controlled level. To ensure that the fluoride supplement in your water provides optimal dental protection, the State Department of Health requires that we monitor fluoride levels on a daily basis to make sure fluoride is maintained at a target level of 0.7 mg/l. During 2024, monitoring showed fluoride levels in your water were within 0.15 mg/l of the target level for 98.90% of the time. Our fluoride levels were between 0.16 mg/l and 0.86 mg/l, with an average level of 0.69 mg/l. None of the monitoring results showed fluoride at levels that approach the 2.2 mg/l MCL for fluoride.

WHAT DOES THIS INFORMATION MEAN?

As you can see by the table, our system had no violations. We have learned through our testing that some contaminants have been detected, however, these contaminants were below the levels allowed by the state. We are required to present the following information on lead in drinking water.

LEAD

Lead can cause serious health effects in people of all ages, especially pregnant people, infants (both formula-fed and breastfed), and young children. Lead in drinking water is primarily from materials and parts used in service lines and in home plumbing. The Village of Dansville is responsible for providing high quality drinking water and removing lead pipes but cannot control the variety of materials used in the plumbing in your home. Because lead levels may vary over time, lead exposure is possible even when your tap sampling results do not detect lead at one point in time. You can help protect yourself and your family by identifying and removing lead materials within your home plumbing and taking steps to reduce your family's risk. Using a filter, certified by an American National Standards Institute accredited certifier to reduce lead, is effective in reducing lead exposures. Follow the instructions provided with the filter to ensure the filter is used properly. Use only cold water for drinking, cooking, and making baby formula. Boiling water does not remove lead from water. Before using tap water for drinking, cooking, or making baby formula, flush your pipes for several minutes. You can do this by running your tap, taking a shower, doing laundry or a load of dishes. If you have a lead service line or galvanized requiring replacement service line, you may need to flush your pipes for a longer period. If you are concerned about lead in your water and wish to have your water tested, contact the Village of Dansville. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available at <https://www.epa.gov/safewater/lead>.

IS OUR WATER SYSTEM MEETING OTHER RULES THAT GOVERN OPERATIONS?

The Village of Dansville public water supply met all monitoring, operating, and reporting requirements throughout 2024.

INFORMATION ON LEAD SERVICE LINE INVENTORY

A Lead Service Line (LSL) is defined as any portion of pipe that is made of lead which connects the water main to the building inlet. An LSL may be owned by the water system, owned by the property owner, or both. The inventory includes both potable and non-potable SLs within a system. In accordance with the federal Lead and Copper Rule Revisions (LCRR) our system has prepared a lead service line inventory and have made it publicly accessible by contacting the Village Office at 335-5330.

DO I NEED TO TAKE SPECIAL PRECAUTIONS?

Although our drinking water met or exceeded state and federal regulations, some people may be more vulnerable to disease causing microorganisms or pathogens in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice from their health care provider about their drinking water. EPA/CDC guidelines on appropriate means to lessen the risk of infection by Cryptosporidium, Giardia and other microbial pathogens are available from the Safe Drinking Water Hotline (800-426-4791).

WHY SAVE WATER AND HOW TO AVOID WASTING IT?

Although our system has an adequate amount of water to meet present and future demands, there are a number of reasons why it is important to conserve water:

- ◆ Saving water saves energy and some of the costs associated with both of these necessities of life;
- ◆ Saving water reduces the cost of energy required to pump water and the need to construct costly new wells, pumping systems and water towers; and
- ◆ Saving water lessens the strain on the water system during a dry spell or drought, helping to avoid severe water use restrictions so that essential firefighting needs are met.

You can play a role in conserving water by becoming conscious of the amount of water your household is using, and by looking for ways to use less whenever you can. It is not hard to conserve water. Conservation tips include:

- Automatic dishwashers use 15 gallons for every cycle, regardless of how many dishes are loaded. So get a run for your money and load it to capacity.
- Turn off the tap when brushing your teeth.
- Check every faucet in your home for leaks. Just a slow drip can waste 15 to 20 gallons a day. Fix it up and you can save almost 6,000 gallons per year.
- Check your toilets for leaks by putting a few drops of food coloring in the tank, watch for a few minutes to see if the color shows up in the bowl. It is not uncommon to lose up to 100 gallons a day from one of these otherwise invisible toilet leaks. Fix it and you save more than 30,000 gallons a year.
- Use your water meter to detect hidden leaks. Simply turn off all taps and water using appliances, then check the meter after 15 minutes, if it moved, you have a leak.

SYSTEM MAINTENANCE AND IMPROVEMENTS

- The Village continued to electronically map the infrastructure this year.
- The Village replaced all the media in Filter #3 in the Water Plant.
- The Village replaced 4 fire hydrants and 1 main line valve this year.
- The Village installed 1314' of 8" waterline with 3 hydrants and 2 inline valves.
- The Village began upgrading road to our intake at the Little Mill Creek and that is ongoing.

CLOSING

Thank you for allowing us to continue to provide your family with quality drinking water this year. We ask that all our customers help us protect our water sources, which are the heart of our community and our way of life. Please call our office (335-5270) if you have questions.