

# 2024 drinking water quality report

WESTBURY WATER DISTRICT

PUBLIC WATER SUPPLY IDENTIFICATION NO. 2902856

## ANNUAL WATER SUPPLY REPORT

MAY 2025

The Westbury Water District is pleased to present to you this year's Water Quality Report. The report is required to be delivered to all residents of our District in compliance with Federal and State regulations.

This report is designed to inform you about the quality water and services we deliver to you every day. Our constant goal is to provide you with a safe and dependable supply of drinking water. We also want you to understand the efforts we make to continually improve the water treatment process and protect our water resources. The Board of Water Commissioners and the District employees are committed to ensuring that you and your family receive the highest quality water.

## SOURCE OF OUR WATER

The source of water for the District is groundwater pumped from ten (10) wells located throughout the community that are drilled into the Magothy aquifer beneath Long Island, as shown on the adjacent figure. Generally, the water quality of the aquifer is good to excellent, although there are localized areas of contamination.


The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activities. Contaminants that may be present in source water include: microbial contaminants; inorganic contaminants; pesticides and herbicides; organic chemical contaminants; and radiological contaminants.

In order to ensure that tap water is safe to drink, the State and the EPA prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. The State Health Department's and the FDA's regulations establish limits for contaminants in bottled water which must provide the same protection for public health.

The population served by the Westbury Water District during 2024 was 22,500. The total amount of water withdrawn from the aquifer in 2024 was 1.28 billion gallons, of which approximately 93 percent was billed directly to consumers. The water not billed to our customers was used for fire fighting and training, system flushing and loss because of an occasional water main break.

## COST OF WATER

The District bills its consumers utilizing a step billing schedule, as shown on the adjacent table. The average cost of water is \$1.50 per 1,000 gallons.

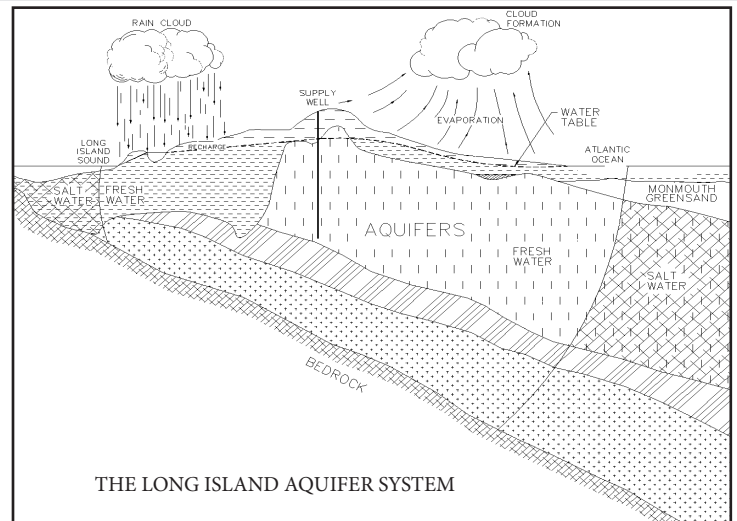

### Step Billing Schedule

| Water Use Per<br>6 Month Period | Cost<br>(per 1,000 Gallons)          |
|---------------------------------|--------------------------------------|
| 0 to 20,000 gallons             | \$30.00<br>(min. per billing period) |
| 20,001 to 60,000                | \$1.50                               |
| 60,001 to 100,000               | \$1.75                               |
| 100,001 to 150,000              | \$2.00                               |
| 150,001 to 200,000              | \$2.40                               |
| Over 200,000                    | \$2.80                               |

## WATER TREATMENT

The Westbury Water District provides treatment at all wells to improve the quality of the water pumped prior to distribution to the consumer. The pH of the pumped water is adjusted upward to reduce corrosive action between the water and water mains and in-house plumbing by the addition of sodium hydroxide. The District adds small amounts of calcium hypochlorite (chlorine) as a disinfection agent as required by the Nassau County Department of Health and New York State Health Department. An air stripping tower facility is utilized to treat potable water from Well Nos. 6 and 7 for the removal of volatile organic compounds. The District is in the process of designing and constructing AOP wellhead treatment systems at Well Nos. 6/7A and Well Nos. 10 and 14 for the removal of 1,4-Dioxane. We are also designing and constructing a GAC filtration system at Well No. 12 for the removal of PFAS. Well Nos. 6/7A, 12A and 14 were out of service in 2024 due to construction.

## WATER QUALITY

In accordance with State regulations, the Westbury Water District routinely monitors your drinking water for numerous parameters and contaminants. We test your drinking water for coliform bacteria, turbidity, inorganic contaminants, lead and copper, nitrate, volatile organic contaminants, total trihalomethanes and synthetic organic contaminants. Over 135 separate parameters are tested for in each of our wells numerous times per year. The table presented in this report depicts which parameters or contaminants were detected in your drinking water. It should be noted that many of these parameters are naturally found in all Long Island drinking water and do not pose any adverse health affects. We are happy to report that the District's water supply is in full compliance with all Federal, State and County regulations and that no water quality violations exist.

## NEW YORK STATE MANDATORY HEALTH ADVISORY

Some people may be more vulnerable to disease causing microorganisms or pathogens in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly and infants can be particularly at risk from infections. These people should seek advice from their health care provider about their drinking water. EPA/CDC guidelines on appropriate means to lessen the risk of infection by Cryptosporidium, Giardia and other microbial pathogens are available from the Safe Drinking Water Hotline 1-800-426-4791.

Water from the Westbury Water District has a slightly elevated nitrate level, but well below the maximum contaminant level of 10.0 parts per million. Nitrate in drinking water at levels above 10 ppm is a health risk for infants of less than six months of age. High nitrate levels in drinking water can cause blue baby syndrome. The source of the nitrates is the nitrogen in fertilizers and from on-site septic systems. If you are caring for an infant you should ask advice from your health care provider.

During 2023, the District collected 30 samples for lead and copper. The 90% level is presented in the table as the maximum result. The next round of samples will occur in 2026.

## WATER CONSERVATION MEASURES

The underground water system of Long Island has more than enough water for present water demands. However, saving water will ensure that our future generations will always have a safe and abundant water supply.

In 2024, the Westbury Water District continued to implement a water conservation program in order to minimize any unnecessary water use. The pumpage for 2024 was 13.4 percent more than in 2023. This increase in water use can most likely be attributed to the hotter and drier weather in 2024.

Residents of the District can also implement their own water conservation measures such as retrofitting plumbing fixtures with flow restrictors, modifying automatic lawn sprinklers to include rain sensors, repairing leaks in the home, installing water conservation fixtures/appliances and maintaining a daily awareness of water conservation in their personal habits. The Water District will provide residents with dye tablets for testing of toilet leaks. In addition, the Nassau County Lawn Sprinkler Regulation are still in effect that require odd-even day sprinkling. Besides protecting our precious underground water supply, water conservation will produce a cost savings to the consumer in terms of both water and energy bills (hot water).

## CONTACTS FOR ADDITIONAL INFORMATION

We are pleased to report that our drinking water is safe and meets all Federal and State requirements. If you have any questions about this report or concerning your water utility, please contact Supt. Matteo Di Nuzzo at the Water District at (516) 333-0427 or the Nassau County Department of Health at (516) 227-9692. We want our valued customers to be informed about our water system. If you want to learn more, please attend any of our regularly scheduled meetings. They are normally held each Wednesday at 4:00 p.m. at the Water District office.

The Westbury Water District routinely monitors for different parameters and contaminants in your drinking water as required by Federal and State laws. All drinking water, including bottled drinking water, may be reasonably expected to contain at least small amounts of some contaminants. It's important to remember that the presence of these contaminants does not necessarily pose a health risk. For more information on contamination and potential health risks, please contact the USEPA Safe Drinking Water Hotline at 1-800-426-4791 or [www.epa.gov/safewater](http://www.epa.gov/safewater).

The Westbury Water District conducts over 10,000 water quality tests throughout the year, testing for over 135 different contaminants which have been undetected in our water supply including:

|                                |                            |                           |                           |
|--------------------------------|----------------------------|---------------------------|---------------------------|
| 1,1,1,2-Tetrachloroethane      | Beryllium                  | Ethylbenzene              | 8:2FTS                    |
| 1,1,2,2-Tetrachloroethane      | bis(2-Ethylhexyl)adipate   | Fluoride                  | 4:2FTS                    |
| 1,1,2-Trichloroethane          | bis(2-Ethylhexyl)phthalate | gamma-BHC (Lindane)       | 6:2FTS                    |
| 1,1,2-Trichlorotrifluoroethane | Bromobenzene               | Glyphosate                | HFPO-DA                   |
| 1,1-Dichloropropene            | Bromochloromethane         | Haloacetic Acids (Total)  | ADONA                     |
| 1,2,3-Trichlorobenzene         | Bromoform                  | Heptachlor                | 9CI-PF3ONS                |
| 1,2,3-Trichloropropane         | Bromomethane               | Heptachlor epoxide        | NFDHA                     |
| 1,2,4-Trichlorobenzene         | Butachlor                  | Hexachloro-1,3-butadiene  | PFEESA                    |
| 1,2,4-Trimethylbenzene         | Cadmium                    | Hexachlorobenzene         | PFMPA                     |
| 1,2-Dibromo-3-chloropropane    | Carbaryl                   | Hexachlorocyclopentadiene | PFMBA                     |
| 1,2-Dibromomethane (EDB)       | Carbofuran                 | Isopropylbenzene (Cumene) | PFBS                      |
| 1,2-Dichlorobenzene            | Carbon tetrachloride       | Lead                      | PFDA                      |
| 1,2-Dichloroethane             | Chlordane (Technical)      | m&p-Xylene                | PFDoA                     |
| 1,2-Dichloropropane            | Chlorobenzene              | Manganese                 | PFHpS                     |
| 1,3,5-Trimethylbenzene         | Chlorodifluoromethane      | MBAS, Calculated as LAS   | PFPeS                     |
| 1,3-Dichlorobenzene            | Chloroethane               | Mercury                   | PFUnA                     |
| 1,3-Dichloropropane            | Chloroform                 | Methomyl                  | Picloram                  |
| 1,4-Dichlorobenzene            | Chloromethane              | Methoxychlor              | p-Isopropyltoluene        |
| 2,2-Dichloropropane            | Chromium                   | Methylene Chloride        | Propachlor                |
| 2,4,5-TP (Silvex)              | cis-1,2-Dichloroethene     | Methyl-tert-butyl ether   | sec-Butylbenzene          |
| 2-Chlorotoluene                | cis-1,3-Dichloropropene    | Metolachlor               | Selenium                  |
| 3-Hydroxycarbofuran            | Cyanide, Free              | Metribuzin                | Silver                    |
| 4-Chlorotoluene                | Dalapon                    | Monobromoacetic Acid      | Simazine                  |
| Alachlor                       | Dibromoacetic Acid         | Monochloroacetic Acid     | Styrene                   |
| Aldicarb                       | Dibromomethane             | n-Butylbenzene            | tert-Butylbenzene         |
| Aldicarb sulfone               | Dicamba                    | Nitrite as N              | Thallium                  |
| Aldicarb sulfoxide             | Dichloroacetic Acid        | Nitrogen, Ammonia         | Toluene                   |
| Aldrin                         | Dichlorodifluoromethane    | n-Propylbenzene           | Toxaphene                 |
| Antimony                       | Dieldrin                   | Odor @ 60 Degrees C       | trans-1,2-Dichloroethene  |
| Apparent Color                 | Dinoseb                    | Oxamyl                    | trans-1,3-Dichloropropene |
| Arsenic                        | Diquat                     | o-Xylene                  | Trichloroacetic Acid      |
| Atrazine                       | E.coli                     | PCB Screen                | Trichlorofluoromethane    |
| Benzene                        | Endothall                  | Pentachlorophenol         | Vinyl chloride            |
| Benzo(a)pyrene                 | Endrin                     | 11CI-PF3OUdS              |                           |

# 2024 DRINKING WATER QUALITY REPORT - TABLE OF DETECTED PARAMETERS

| Contaminants                  | Violation (Yes/No) | Date of Sample | Level Detected (Maximum Range)        | Unit Measurement | MCLG | Regulatory Limit (MCL or AL) | Likely Source of Contaminant                                         |
|-------------------------------|--------------------|----------------|---------------------------------------|------------------|------|------------------------------|----------------------------------------------------------------------|
| Lead & Copper                 |                    |                |                                       |                  |      |                              |                                                                      |
| Copper                        | No                 | June/July 2023 | 0.010 - 0.190<br>0.088 <sup>(1)</sup> | mg/l             | 1.3  | AL = 1.3                     | Corrosion of household plumbing systems; Erosion of natural deposits |
| Lead                          | No                 | June/July 2023 | ND - 1.2<br>ND <sup>(1)</sup>         | ug/l             | 0    | AL = 15                      | Corrosion of household plumbing systems; Erosion of natural deposits |
| Inorganic Contaminants        |                    |                |                                       |                  |      |                              |                                                                      |
| Barium                        | No                 | 05/08/24       | 0.026 (ND - 0.026)                    | mg/l             | 2    | MCL = 2.0                    | Naturally occurring                                                  |
| Sodium                        | No                 | 05/08/24       | 35.2 (3.1 - 35.2)                     | mg/l             | n/a  | No MCL <sup>(2)</sup>        |                                                                      |
| Iron                          | No                 | 05/08/24       | 0.047 (ND - 0.047)                    | ug/l             | n/a  | MCL = 300 <sup>(3)</sup>     |                                                                      |
| Zinc                          | No                 | 05/08/24       | 0.056 (ND - 0.056)                    | mg/l             | n/a  | MCL = 5                      |                                                                      |
| Chloride                      | No                 | 05/08/24       | 109.0 (3.1 - 109.0)                   | mg/l             | n/a  | MCL = 250                    |                                                                      |
| Calcium                       | No                 | 05/08/24       | 17.6 (0.98 - 17.6)                    | mg/l             | None | No MCL                       |                                                                      |
| Turbidity                     | No                 | 05/08/24       | 1.3 (ND - 1.3)                        | NTU              | n/a  | MCL = 5                      |                                                                      |
| Magnesium                     | No                 | 05/08/24       | 6.3 (0.74 - 6.3)                      | mg/l             | None | No MCL                       |                                                                      |
| Nickel                        | No                 | 05/08/24       | 3.3 (0.96 - 3.3)                      | ug/l             | n/a  | No MCL                       |                                                                      |
| Sulfate                       | No                 | 05/08/24       | 15.8 (ND - 15.8)                      | mg/l             | n/a  | MCL = 250                    |                                                                      |
| Nitrate                       | No                 | 10/08/24       | 5.2 (2.5 - 5.2)                       | mg/l             | 10   | MCL = 10                     | Runoff from fertilizer and leaching from septic tanks and sewage     |
| Nitrate-Nitrite               | No                 | 10/08/24       | 5.2 (2.5 - 5.2)                       | mg/l             | 10   | MCL = 10                     |                                                                      |
| Perchlorate                   | No                 | 11/12/24       | 8.9 (ND - 8.9)                        | ug/l             | 0    | AL = 18 <sup>(4)</sup>       | Fertilizer                                                           |
| Volatile Organic Contaminants |                    |                |                                       |                  |      |                              |                                                                      |
| Trichloroethene               | No                 | 08/13/24       | 1.7 (ND - 1.7)                        | ug/l             | 0    | MCL = 5                      | Discharge from industrial facilities                                 |
| Tetrachloroethene             | No                 | 07/02/24       | 4.7 (ND - 4.7)                        | ug/l             | 0    | MCL = 5                      |                                                                      |
| 1,1-Dichloroethane            | No                 | 02/05/24       | 1.9 (ND - 1.9)                        | ug/l             | 0    | MCL = 5                      |                                                                      |
| 1,1-Dichloroethene            | No                 | 08/13/24       | 2.7 (ND - 2.7)                        | ug/l             | 0    | MCL = 5                      |                                                                      |
| 1,1,1-Trichloroethane         | No                 | 08/13/24       | 0.71 (ND - 0.71)                      | ug/l             | 0    | MCL = 5                      |                                                                      |
| Radionuclides                 |                    |                |                                       |                  |      |                              |                                                                      |
| Gross Alpha                   | No                 | 09/11/24       | 3.64 (ND - 3.64)                      | pCi/L            | n/a  | MCL = 15                     | Naturally occurring                                                  |
| Gross Beta                    | No                 | 09/11/24       | 3.75 (ND - 3.75)                      | pCi/L            | n/a  | MCL = 50                     |                                                                      |
| Combined Radium 226 & 228     | No                 | 09/11/24       | 2.87 (ND - 2.87)                      | pCi/L            | n/a  | MCL = 5                      |                                                                      |
| Uranium                       | No                 | 09/11/24       | 1.82 (ND - 1.82)                      | ug/l             | n/a  | MCL = 30                     |                                                                      |
| Disinfectants                 |                    |                |                                       |                  |      |                              |                                                                      |
| Chlorine Residual             | No                 | 02/12/24       | 1.29 (0.6 - 1.29)                     | mg/l             | n/a  | MRDL = 4                     | Measure of disinfectants                                             |
| Physical Characteristics      |                    |                |                                       |                  |      |                              |                                                                      |
| pH                            | No                 | 05/08/24       | 6.2 (5.7 - 6.2)                       | pH units         | n/a  | 7.5 - 8.5                    | Measure of acidity or alkalinity                                     |
| Total Alkalinity              | No                 | 05/08/24       | 21.5 (4.9 - 21.5)                     | mg/l             | n/a  | No MCL                       | Naturally occurring                                                  |
| Calcium Hardness              | No                 | 05/08/24       | 43.9 (2.5 - 43.9)                     | mg/l             | n/a  | No MCL                       |                                                                      |
| Total Dissolved Solids (TDS)  | No                 | 05/08/24       | 217.0 (ND - 217.0)                    | mg/l             | n/a  | No MCL                       |                                                                      |
| Total Hardness                | No                 | 05/08/24       | 70.0 (5.5 - 70.0)                     | mg/l             | n/a  | No MCL                       |                                                                      |

# 2024 DRINKING WATER QUALITY REPORT - TABLE OF DETECTED PARAMETERS

| Contaminants                                                   | Violation (Yes/No) | Date of Sample | Level Detected (Maximum Range) | Unit Measurement | MCLG | Regulatory Limit (MCL or AL) | Likely Source of Contaminant        |
|----------------------------------------------------------------|--------------------|----------------|--------------------------------|------------------|------|------------------------------|-------------------------------------|
| Synthetic Organic Contaminants (SOCs)                          |                    |                |                                |                  |      |                              |                                     |
| 1,4-Dioxane                                                    | No                 | 11/14/24       | 0.86 (ND - 0.86)               | ug/l             | n/a  | MCL = 1.0                    | Industrial discharge <sup>(5)</sup> |
| 2,4-D                                                          | No                 | 11/14/24       | 0.14 (ND - 0.14)               | ug/l             | 0    | MCL = 50                     | Industrial discharge                |
| Perfluorooctanesulfonic Acid (PFOS)                            | No                 | 11/19/24       | 5.21 (ND - 5.21)               | ng/l             | 0    | MCL = 10.0                   | Industrial discharge <sup>(6)</sup> |
| Perfluorooctanocic Acid (PFOA)                                 | No                 | 11/19/24       | 10.4 (ND - 10.4)               | ng/l             | 0    | MCL = 10.0                   |                                     |
| Unregulated Contaminant Monitoring Rule (UCMR5) <sup>(7)</sup> |                    |                |                                |                  |      |                              |                                     |
| Perfluorobutanoic Acid (PFBA)                                  | No                 | 12/05/24       | 4.97 (ND - 4.97)               | ng/l             | n/a  | MCL = 50,000                 | Industrial discharge                |
| Perfluoroheptanoic Acid (PFHpA)                                | No                 | 11/19/24       | 4.35 (ND - 4.35)               | ng/l             | n/a  | MCL = 50,000                 |                                     |
| Perfluorohexanesulfonic Acid (PFHxS)                           | No                 | 12/05/24       | 1.83 (ND - 1.83)               | ng/l             | n/a  | MCL = 50,000                 |                                     |
| Perfluorohexanoic Acid (PFHxA)                                 | No                 | 11/19/24       | 6.18 (ND - 6.18)               | ng/l             | n/a  | MCL = 50,000                 |                                     |
| Perfluorononanoic Acid (PFNA)                                  | No                 | 12/05/24       | 2.82 (ND - 2.82)               | ng/l             | n/a  | MCL = 50,000                 |                                     |
| Perfluoropentanoic Acid (PFPeA)                                | No                 | 12/05/24       | 6.63 (ND - 6.63)               | ng/l             | n/a  | MCL = 50,000                 |                                     |
| Disinfection By-Products                                       |                    |                |                                |                  |      |                              |                                     |
| Bromodichloromethane                                           | No                 | 02/05/24       | 0.56 (ND - 0.56)               | ug/l             | 0    | n/a                          | Disinfection By-Product             |
| Dibromochloromethane                                           | No                 | 02/05/24       | 0.69 (ND - 0.69)               | ug/l             | 0    | n/a                          | Disinfection By-Product             |
| Total Trihalomethane                                           | No                 | 02/05/24       | 1.2 (ND - 1.2)                 | ug/l             | 0    | MCL = 80                     | Disinfection By-Product             |

## Definitions:

**Maximum Contaminant Level (MCL)** - The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible.

**Maximum Contaminant Level Goal (MCLG)** - The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

**Maximum Residual Disinfection Level (MRDL)** - The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

**Maximum Residual Disinfection Level Goal (MRDLG)** - The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

**Action Level (AL)** - The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

**Health Advisory (HA)** - An estimate of acceptable drinking water levels for a chemical substance based on health effects information; a health advisory is not a legally enforceable Federal standard, but serves as technical guidance to assist Federal, State and local officials.

**Milligrams per liter (mg/l)** - Corresponds to one part of liquid in one million parts of liquid (parts per million - ppm).

**Micrograms per liter (ug/l)** - Corresponds to one part of liquid in one billion parts of liquid (parts per billion - ppb).

**Nanograms per liter (ng/l)** - Corresponds to one part of liquid in one trillion parts of liquid (parts per trillion - ppt).

**Non-Detects (ND)** - Laboratory analysis indicates that the constituent is not present.

**Nephelometric Turbidity Unit (NTU)** - Signifies that the instrument is measuring scattered light from the sample at a 90-degree angle from the incident light.

**pCi/L** - pico Curies per Liter is a measure of radioactivity in water.

**ppt** - parts per trillion

<sup>(1)</sup> - During 2023, we collected and analyzed 30 samples for lead and copper. The action levels for both lead and copper were not exceeded at any site tested. The next sampling program for lead and copper will be conducted in 2026. The values reported for lead and copper represent the 90th percentile. A percentile is a value on a scale of 100 that indicates the percent of a distribution that is equal to or below it. The 90th percentile is equal to or greater than 90% of the lead and copper values detected at your water system. In our sampling program, the 90th percentile value is the 4th highest result.

<sup>(2)</sup> - No MCL has been established for sodium. However, 20 mg/l is a recommended guideline for people on high restricted sodium diets and 270 mg/l for those on moderate sodium diets.

<sup>(3)</sup> - If iron and manganese are present, the total concentration of both should not exceed 500 ug/l. Iron is essential for maintaining good health. However, too much iron can cause adverse health effects. Drinking water with very large amounts of iron can cause nausea, vomiting, diarrhea, constipation and stomach pain. These effects usually diminish once the elevated iron exposure is stopped. A small number of people have a condition called hemochromatosis, in which the body absorbs and stores too much iron. People with hemochromatosis may be at greater risk for health effects resulting from too much iron in the body (sometimes called "iron overload") and should be aware of their overall iron intake. The New York State standard for iron in drinking water is 0.3 milligrams per liter, and is based on iron's effects on the taste, odor and color of the water.

<sup>(4)</sup> - Perchlorate is an unregulated contaminant. However, the State Health Dept. has established an action level of 18 ug/l.

<sup>(5)</sup> - It is used as a solvent for cellulose formulations, resins, oils, waxes and other organic substances. It is also used in wood pulping, textile processing, degreasing, in lacquers, paints, varnishes, and stains; and in paint and varnish removers.

<sup>(6)</sup> - PFOA has been used to make carpets, leathers, textiles, fabrics for furniture, paper packaging, and other materials that are resistant to water, grease, or stains. It is also used in firefighting foams at airfields. Many of these uses have been phased out by its primary U.S. manufacturer; however, there are still some ongoing uses.

<sup>(7)</sup> - All perfluoroalkyl substances, besides PFOA and PFOS, are considered Unspecified Organic Contaminants (UOC) which have an MCL = 50,000 ng/L

## INFORMATION ON LEAD SERVICE LINE INVENTORY

Lead can cause serious health effects in people of all ages, especially pregnant people, infants (both formula-fed and breastfed), and young children. Lead in drinking water is primarily from materials and parts used in service lines and in home plumbing. The Westbury Water District is responsible for providing high quality drinking water and removing lead pipes, but cannot control the variety of materials used in the plumbing in your home. Because lead levels may vary over time, lead exposure is possible even when your tap sampling results do not detect lead at one point in time. You can help protect yourself and your family by identifying and removing lead materials within your home plumbing and taking steps to reduce your family's risk. Using a filter, certified by an American National Standards Institute accredited certifier to reduce lead, is effective in reducing lead exposures. Follow the instructions provided with the filter to ensure the filter is used properly. Use only cold water for drinking, cooking, and making baby formula. Boiling water does not remove lead from water. Before using tap water for drinking, cooking, or making baby formula, flush your pipes for several minutes. You can do this by running your tap, taking a shower, doing laundry or a load of dishes. If you have a lead service line or galvanized requiring replacement service line, you may need to flush your pipes for a longer period. To better understand your exposure to lead from your home plumbing, you can get your water tested by a New York State certified laboratory for lead in drinking water. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available at <https://www.epa.gov/safewater/lead>.

A Lead Service Line (LSL) is defined as any portion of pipe that is made of lead which connects the water main to the building inlet. An LSL may be owned by the water system, owned by the property owner, or both. The inventory includes both potable and nonpotable SLs within a system. In accordance with the federal Lead and Copper Rule Revisions (LCRR), the District has prepared a lead service line inventory which is available to the public at the Water District Office located at 160 Drexel Avenue, Westbury, New York.

## SOURCE WATER ASSESSMENT

The NYSDOH, with assistance from the local health department, has completed a source water assessment for this system, based on available information. Possible and actual threats to this drinking water source were evaluated. The source water assessment includes a susceptibility rating based on the risk posed by each potential source of contamination and how rapidly contaminants can move through the subsurface to the wells. The susceptibility of a water supply well to contamination is dependent upon both the presence of potential sources of contamination within the well's contributing area and the likelihood that the contaminant can travel through the environment to reach the well. The susceptibility rating is an estimate of the potential for contamination of the source water, it does not mean that the water delivered to consumers is, or will become contaminated. See the section entitled "Water Quality" for a list of the contaminants that have been detected. The source water assessments provide resource managers with additional information for protecting source waters into the future.

Drinking water is derived from 10 wells. The source water assessment has rated most of the wells as having a high susceptibility to nitrates, and three (3) of those wells as having very high susceptibility to industrial solvents. The elevated susceptibility to nitrates is due primarily to commercial, institutional and residential land use and related practices, such as fertilizing lawns in the assessment area. The elevated susceptibility to industrial solvents is due primarily to point sources of contamination related to commercial/industrial facilities and related practices in the assessment area.

A copy of the assessment, including a map of the assessment area, can be obtained by contacting the Water District.

Copies of a Supplemental Data Package, which includes the water quality data for each of our supply wells utilized during 2024, are available at the Westbury Water District office located at 160 Drexel Avenue, Westbury, New York and the local Public Library.

We at Westbury Water District work around the clock to provide top quality water to every tap throughout the community. We ask that all our customers help us protect our water resources, which are the heart of our community, our way of life and our children's future.

### INFORMATION FOR NON-ENGLISH SPEAKING RESIDENTS

#### Spanish

*Este informe contiene información muy importante sobre su agua beber. Tradúzcalo o hable con alguien que lo entienda bien.*

---

Westbury Water District  
160 Drexel Avenue  
Westbury, New York 11590

**Board of Commissioners**

Rodney Caines

Kelby Then

Barry Green

**Superintendent**

Matteo Di Nuzzo

WESTBURY WATER FIRE DIST.  
SUPPLEMENTAL WATER QUALITY TABLE 2024

|                                     |        |       | Well 6       |     |     | Well 9       |      |      | Well 10      |       |       | Well 11      |       |       | Well 12      |       |       |              |      |      |
|-------------------------------------|--------|-------|--------------|-----|-----|--------------|------|------|--------------|-------|-------|--------------|-------|-------|--------------|-------|-------|--------------|------|------|
|                                     |        |       | Raw Well     |     |     | Raw Well     |      |      | Raw Well     |       |       | Raw Well     |       |       | Raw Well     |       |       | Treated Well |      |      |
| ANALYTES                            | M.C.L. | Units | SAMPLE COUNT | MAX | AVG | SAMPLE COUNT | MAX  | AVG  | SAMPLE COUNT | MAX   | AVG   | SAMPLE COUNT | MAX   | AVG   | SAMPLE COUNT | MAX   | AVG   | SAMPLE COUNT | MAX  | AVG  |
| INORGANICS                          |        |       |              |     |     |              |      |      |              |       |       |              |       |       |              |       |       |              |      |      |
| Antimony                            | 6      | ug/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | ND    | ND    | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Apparent Color                      | 15     | units | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | ND    | ND    | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Arsenic                             | 10     | ug/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | ND    | ND    | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Barium                              | 2      | mg/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | 0.011 | 0.011 | 1            | 0.006 | 0.006 | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Beryllium                           | 4      | ug/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | ND    | ND    | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Ca Hardness as CaCO3 (SM 2340B      | n/a    | mg/L  | n/a          | n/a | n/a | 1            | 2.50 | 2.50 | 1            | 22.80 | 22.80 | 1            | 12.90 | 12.90 | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Cadmium                             | 5      | ug/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | ND    | ND    | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Chloride                            | 250    | mg/L  | n/a          | n/a | n/a | 1            | 3.10 | 3.10 | 1            | 19.30 | 19.30 | 1            | 11.80 | 11.80 | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Chromium                            | 100    | mg/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | ND    | ND    | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Copper                              | 1.3    | mg/L  | n/a          | n/a | n/a | 1            | 0.01 | 0.01 | 1            | 0.00  | 0.00  | 1            | 0.01  | 0.01  | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Fluoride                            | 2.2    | mg/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | ND    | ND    | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Iron                                | 0.3    | mg/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | 0.05  | 0.05  | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Lead                                | 15     | ug/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | ND    | ND    | 2            | ND    | ND    | 2            | ND   | ND   |
| Manganese                           | 0.3    | mg/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | ND    | ND    | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| MBAS, Calculated as LAS             | n/a    | mg/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | ND    | ND    | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Mercury                             | 2      | ug/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | ND    | ND    | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Nickel                              | n/a    | mg/L  | n/a          | n/a | n/a | 1            | 0.00 | 0.00 | 1            | 0.00  | 0.00  | 1            | 0.00  | 0.00  | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Nitrate as N                        | 10     | mg/L  | n/a          | n/a | n/a | 13           | ND   | ND   | 13           | 5.20  | 4.59  | 2            | 4.90  | 4.25  | 3            | 4.20  | 3.97  | n/a          | n/a  | n/a  |
| Nitrate-Nitrite (as N)              | 10     | mg/L  | n/a          | n/a | n/a | 13           | ND   | ND   | 13           | 5.20  | 4.60  | 2            | 4.90  | 4.25  | 3            | 4.20  | 4.00  | n/a          | n/a  | n/a  |
| Nitrite as N                        | 1      | mg/L  | n/a          | n/a | n/a | 13           | ND   | ND   | 13           | ND    | ND    | 2            | ND    | ND    | 3            | ND    | ND    | n/a          | n/a  | n/a  |
| Nitrogen, Ammonia                   | n/a    | mg/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | ND    | ND    | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Odor @ 60 Degrees C                 | 3      |       | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | ND    | ND    | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Selenium                            | 50     | ug/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | ND    | ND    | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Silver                              | 0.1    | mg/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | ND    | ND    | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Sodium                              | 270    | mg/L  | n/a          | n/a | n/a | 1            | 3.10 | 3.10 | 1            | 13.90 | 13.90 | 1            | 8.40  | 8.40  | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Sulfate                             | 250    | mg/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | 7.50  | 7.50  | 1            | ND    | ND    | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Thallium                            | 2      | ug/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | ND    | ND    | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Zinc                                | 5      | mg/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | 0.06  | 0.06  | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Calcium                             | n/a    | mg/L  | n/a          | n/a | n/a | 1            | 0.98 | 0.98 | 1            | 9.20  | 9.20  | 1            | 5.20  | 5.20  | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Cyanide, Free                       | 200    | ug/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 1            | ND    | ND    | 1            | ND    | ND    | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Magnesium                           | n/a    | mg/L  | n/a          | n/a | n/a | 1            | 0.74 | 0.74 | 1            | 3.30  | 3.30  | 1            | 2.20  | 2.20  | n/a          | n/a   | n/a   | n/a          | n/a  | n/a  |
| Perchlorate                         | 18     | ug/L  | n/a          | n/a | n/a | 1            | ND   | ND   | 3            | 1.80  | 1.60  | 1            | 1.20  | 1.20  | 2            | ND    | ND    | n/a          | n/a  | n/a  |
| VOLATILE ORGANIC CONTAMINANTS       |        |       |              |     |     |              |      |      |              |       |       |              |       |       |              |       |       |              |      |      |
| 1,1,1-Trichloroethane               | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | 0.53  | 0.05  | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| 1,1,2-Trichloroethane               | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| 1,1,2-Trichlorotrifluoroethane      | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| 1,1-Dichloroethene                  | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | 2.00  | 1.57  | 12           | 0.89  | 0.60  | 5            | 1.40  | 1.03  | 6            | ND   | ND   |
| 1,2,4-Trichlorobenzene              | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| 1,2-Dichlorobenzene                 | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| 1,2-Dichloroethane                  | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| 1,2-Dichloropropane                 | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| 1,4-Dichlorobenzene                 | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| Benzene                             | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| Carbon tetrachloride                | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| Chlorobenzene                       | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| cis-1,2-Dichloroethene              | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| Ethylbenzene                        | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| Hexachloro-1,3-butadiene            | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| m&p-Xylene                          | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| Methyl-tert-butyl ether             | 10     | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| o-Xylene                            | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| Styrene                             | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| Tetrachloroethene                   | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | 4.70  | 3.75  | 12           | 0.84  | 0.47  | 5            | 3.70  | 2.22  | 6            | ND   | ND   |
| Toluene                             | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| trans-1,2-Dichloroethene            | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| Trichloroethene                     | 5      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | 0.97  | 0.75  | 5            | 4.20  | 3.08  | 6            | ND   | ND   |
| Vinyl chloride                      | 2      | ug/L  | n/a          | n/a | n/a | 4            | ND   | ND   | 11           | ND    | ND    | 12           | ND    | ND    | 5            | ND    | ND    | 6            | ND   | ND   |
| SYNTHETIC ORGANIC CONTAMINANTS      |        |       |              |     |     |              |      |      |              |       |       |              |       |       |              |       |       |              |      |      |
| 1,4-Dioxane (p-Dioxane)             | 1      | ug/L  | n/a          | n/a | n/a | 12           | ND   | ND   | 12           | 0.81  | 0.63  | 12           | 0.72  | 0.57  | 4            | 0.94  | 0.76  | 2            | 1.20 | 1.03 |
| Perfluorooctanoic Acid (PFOA)       | 10     | ng/l  | n/a          | n/a | n/a | 11           | ND   | ND   | 5            | ND    | ND    | 5            | ND    | ND    | 4            | 29.60 | 26.50 | 6            | ND   | ND   |
| Perfluorooctanesulfonic Acid (PFOS) | 10     | ng/l  | n/a          | n/a | n/a | 11           | ND   | ND   | 5            | ND    | ND    | 5            | ND    | ND    | 4            | 15.50 | 15.00 | 6            | ND   | ND   |

WESTBURY WATER FIRE DIST.  
SUPPLEMENTAL WATER QUALITY TABLE 2024

|                                                                                   |        |       | Well 6       |     |     | Well 9       |     |     | Well 10      |     |     | Well 11      |     |     | Well 12      |       |      |              |     |     |
|-----------------------------------------------------------------------------------|--------|-------|--------------|-----|-----|--------------|-----|-----|--------------|-----|-----|--------------|-----|-----|--------------|-------|------|--------------|-----|-----|
|                                                                                   |        |       | Raw Well     |     |     | Raw Well     |     |     | Raw Well     |     |     | Raw Well     |     |     | Raw Well     |       |      | Treated Well |     |     |
| ANALYTES                                                                          | M.C.L. | Units | SAMPLE COUNT | MAX | AVG | SAMPLE COUNT | MAX | AVG | SAMPLE COUNT | MAX | AVG | SAMPLE COUNT | MAX | AVG | SAMPLE COUNT | MAX   | AVG  | SAMPLE COUNT | MAX | AVG |
| 2,4,5-TP (Silvex)                                                                 | 10     | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| 2,4-D                                                                             | 50     | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Dalapon                                                                           | 50     | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Dicamba                                                                           | 50     | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Dinoseb                                                                           | 7      | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Pentachlorophenol                                                                 | 1      | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Picloram                                                                          | 50     | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Atrazine                                                                          | 3      | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 4            | ND    | ND   | 5            | ND  | ND  |
| Metolachlor                                                                       | 50     | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 3            | ND  | ND  |
| Metribuzin                                                                        | 50     | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 3            | ND  | ND  |
| Propachlor                                                                        | 50     | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 3            | ND  | ND  |
| Simazine                                                                          | 4      | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 4            | ND    | ND   | 5            | ND  | ND  |
| Hexachlorocyclopentadiene                                                         | 5      | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| 3-Hydroxycarbofuran                                                               | 50     | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Aldicarb                                                                          | 3      | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Aldicarb sulfone                                                                  | 2      | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Aldicarb sulfoxide                                                                | 4      | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Carbofuran                                                                        | 40     | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Methomyl                                                                          | 50     | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Oxamyl                                                                            | 200    | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Glyphosate                                                                        | 50     | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Endothall                                                                         | 50     | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Diquat                                                                            | 20     | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Alachlor                                                                          | 2      | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| Chlordane (Technical)                                                             | 2      | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Endrin                                                                            | 2      | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| gamma-BHC (Lindane)                                                               | 0.2    | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| Heptachlor                                                                        | 400    | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| Heptachlor epoxide                                                                | 200    | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| Benzo(a)pyrene                                                                    | 200    | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 4            | ND    | ND   | 5            | ND  | ND  |
| bis(2-Ethylhexyl)adipate                                                          | 400    | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 4            | ND    | ND   | 5            | ND  | ND  |
| bis(2-Ethylhexyl)phthalate                                                        | 6      | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 4            | ND    | ND   | 5            | ND  | ND  |
| Hexachlorobenzene                                                                 | 1      | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| Methoxychlor                                                                      | 40     | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| PCB Screen                                                                        | 0.5    | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| Toxaphene                                                                         | 3      | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| 1,2-Dibromo-3-chloropropane                                                       | 200    | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| 1,2-Dibromoethane (EDB)                                                           | 50     | ug/L  | n/a          | n/a | n/a | 1            | ND  | ND  | 1            | ND  | ND  | 1            | ND  | ND  | 3            | ND    | ND   | 4            | ND  | ND  |
| UCMR5                                                                             |        |       |              |     |     |              |     |     |              |     |     |              |     |     |              |       |      |              |     |     |
| Perfluorobutanesulfonic Acid (PFBS)                                               | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| Perfluoroheptanoic Acid (PFHpA)                                                   | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | 6.92  | 6.65 | 6            | ND  | ND  |
| Perfluorohexanesulfonic Acid (PFHxS)                                              | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | 6.69  | 5.99 | 6            | ND  | ND  |
| Perfluorononanoic Acid (PFNA)                                                     | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | 7.78  | 6.65 | 6            | ND  | ND  |
| 4,8-Dioxa-3h-Perfluorononanoic Acid (ADONA)                                       | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| Perfluoro(2-Ethoxyethane)Sulfonic Acid (PFEESA)                                   | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| Nonafluoro-3,6-Dioxaheptanoic Acid (NFDHA)                                        | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| Perfluorobutanoic Acid (PFBA)                                                     | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | 8.76  | 8.59 | 6            | ND  | ND  |
| Perfluorodecanoic Acid (PFDA)                                                     | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | 2.90  | 2.54 | 6            | ND  | ND  |
| Perfluorododecanoic Acid (PFDoA)                                                  | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| Perfluoroheptanesulfonic Acid (PFHpS)                                             | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| Perfluorohexanoic Acid (PFHxA)                                                    | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | 9.23  | 8.69 | 6            | ND  | ND  |
| Perfluoropentanesulfonic Acid (PFPeS)                                             | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| Perfluoropentanoic Acid (PFPeA)                                                   | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | 10.10 | 9.07 | 6            | ND  | ND  |
| Perfluoroundecanoic Acid (PFUnA)                                                  | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| Perfluoro-3-Methoxypropanoic Acid (PFMPA)                                         | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| Perfluoro-4-Methoxybutanoic Acid (PFMBA)                                          | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| 1H,1H,2H,2H-Perfluorohexanesulfonic Acid (4:2FTS)                                 | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| 1H,1H,2H,2H-Perfluorooctanesulfonic Acid (6:2FTS)                                 | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| 9-Chlorohexadecafluoro-3-Oxanone-1-Sulfonic Acid (9CI-PF3ONS)                     | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| 1H,1H,2H,2H-Perfluorodecanesulfonic Acid (8:2FTS)                                 | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| 11-Chloroeicosafuoro-3-Oxaundecane-1-Sulfonic Acid (11CI-PF3OUdS)                 | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |
| 2,3,3,3-Tetrafluoro-2-[1,1,2,2,3,3,3-Heptafluoropropoxy]-Propanoic Acid (HFPO-DA) | 50,000 | ng/l  | n/a          | n/a | n/a | 11           | ND  | ND  | 5            | ND  | ND  | 5            | ND  | ND  | 4            | ND    | ND   | 6            | ND  | ND  |

WESTBURY WATER FIRE DIST.  
SUPPLEMENTAL WATER QUALITY TABLE 2024

|                                      |        |            | Well 6       |     |     | Well 9       |        |        | Well 10      |        |        | Well 11      |        |        | Well 12      |      |      |              |     |     |
|--------------------------------------|--------|------------|--------------|-----|-----|--------------|--------|--------|--------------|--------|--------|--------------|--------|--------|--------------|------|------|--------------|-----|-----|
|                                      |        |            | Raw Well     |     |     | Raw Well     |        |        | Raw Well     |        |        | Raw Well     |        |        | Raw Well     |      |      | Treated Well |     |     |
| ANALYTES                             | M.C.L. | Units      | SAMPLE COUNT | MAX | AVG | SAMPLE COUNT | MAX    | AVG    | SAMPLE COUNT | MAX    | AVG    | SAMPLE COUNT | MAX    | AVG    | SAMPLE COUNT | MAX  | AVG  | SAMPLE COUNT | MAX | AVG |
| OTHER PRINCIPAL ORGANIC CONTAMINANTS |        |            |              |     |     |              |        |        |              |        |        |              |        |        |              |      |      |              |     |     |
| 1,1,1,2-Tetrachloroethane            | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| 1,1,2,2-Tetrachloroethane            | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| 1,1-Dichloroethane                   | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | 1.80   | 1.31   | 12           | 1.30   | 1.00   | 5            | 1.60 | 1.26 | 6            | ND  | ND  |
| 1,1-Dichloropropene                  | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| 1,2,3-Trichlorobenzene               | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| 1,2,3-Trichloropropane               | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| 1,2,4-Trimethylbenzene               | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| 1,3,5-Trimethylbenzene               | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| 1,3-Dichlorobenzene                  | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| 1,3-Dichloropropane                  | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| 2,2-Dichloropropane                  | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| 2-Chlorotoluene                      | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| 4-Chlorotoluene                      | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| Bromobenzene                         | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| Bromochloromethane                   | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| Bromomethane                         | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| Chlorodifluoromethane                | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| Chloroethane                         | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| Chloromethane                        | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | 0.65 | 0.13 | 6            | ND  | ND  |
| cis-1,3-Dichloropropene              | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| Dibromomethane                       | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| Dichlorodifluoromethane              | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| Isopropylbenzene (Cumene)            | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| Methylene Chloride                   | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| n-Butylbenzene                       | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| n-Propylbenzene                      | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| p-Isopropyltoluene                   | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| sec-Butylbenzene                     | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| tert-Butylbenzene                    | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| trans-1,3-Dichloropropene            | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| Trichlorofluoromethane               | 5      | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| Aldrin                               | 5      | ug/L       | n/a          | n/a | n/a | 1            | ND     | ND     | 1            | ND     | ND     | 1            | ND     | ND     | 3            | ND   | ND   | 4            | ND  | ND  |
| Dieldrin                             | 2      | ug/L       | n/a          | n/a | n/a | 1            | ND     | ND     | 1            | ND     | ND     | 1            | ND     | ND     | 3            | ND   | ND   | 4            | ND  | ND  |
| UNSPECIFIED ORGANIC CONTAMINANTS     |        |            |              |     |     |              |        |        |              |        |        |              |        |        |              |      |      |              |     |     |
| Butachlor                            | 50     | ug/L       | n/a          | n/a | n/a | 1            | ND     | ND     | 1            | ND     | ND     | 1            | ND     | ND     | 3            | ND   | ND   | 3            | ND  | ND  |
| Carbaryl                             | 50     | ug/L       | n/a          | n/a | n/a | 1            | ND     | ND     | 1            | ND     | ND     | 1            | ND     | ND     | 3            | ND   | ND   | 4            | ND  | ND  |
| DISINFECTION BYPRODUCTS              |        |            |              |     |     |              |        |        |              |        |        |              |        |        |              |      |      |              |     |     |
| Bromodichloromethane                 | 50     | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| Bromoform                            | 50     | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| Chloroform                           | 50     | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| Dibromochloromethane                 | 50     | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| Total Trihalomethanes (Calc.)        | 80     | ug/L       | n/a          | n/a | n/a | 4            | ND     | ND     | 11           | ND     | ND     | 12           | ND     | ND     | 5            | ND   | ND   | 6            | ND  | ND  |
| OTHER                                |        |            |              |     |     |              |        |        |              |        |        |              |        |        |              |      |      |              |     |     |
| Alkalinity, Total as CaCO3           | n/a    | mg/L       | n/a          | n/a | n/a | 1            | 4.90   | 4.90   | 1            | 13.50  | 13.50  | 1            | 7.30   | 7.30   | n/a          | n/a  | n/a  | n/a          | n/a | n/a |
| E.coli                               | n/a    |            | 5            | ND  | ND  | 5            | ND     | ND     | 6            | ND     | ND     | 6            | ND     | ND     | 25           | ND   | ND   | 8            | ND  | ND  |
| Field pH                             | n/a    | Std. Units | n/a          | n/a | n/a | 1            | 5.90   | 5.90   | 1            | 5.90   | 5.90   | 1            | 5.90   | 5.90   | n/a          | n/a  | n/a  | n/a          | n/a | n/a |
| Field Residual Chlorine              | 1      | mg/L       | n/a          | n/a | n/a | n/a          | n/a    | n/a    | n/a          | n/a    | n/a    | n/a          | n/a    | n/a    | n/a          | n/a  | n/a  | n/a          | n/a | n/a |
| Field Temperature                    | n/a    | deg C      | n/a          | n/a | n/a | 1            | 15.00  | 15.00  | 1            | 13.90  | 13.90  | 1            | 13.80  | 13.80  | n/a          | n/a  | n/a  | n/a          | n/a | n/a |
| LAS Molecular Weight, g/mol          | n/a    |            | n/a          | n/a | n/a | 1            | 320.00 | 320.00 | 1            | 320.00 | 320.00 | 1            | 320.00 | 320.00 | n/a          | n/a  | n/a  | n/a          | n/a | n/a |
| pH                                   | n/a    | Std. Units | n/a          | n/a | n/a | 1            | 5.70   | 5.70   | 1            | 5.70   | 5.70   | 1            | 6.20   | 6.20   | n/a          | n/a  | n/a  | n/a          | n/a | n/a |
| Tot Hardness asCaCO3 (SM 2340B       | n/a    | mg/L       | n/a          | n/a | n/a | 1            | 5.50   | 5.50   | 1            | 36.50  | 36.50  | 1            | 21.90  | 21.90  | n/a          | n/a  | n/a  | n/a          | n/a | n/a |
| Total Coliforms                      | n/a    |            | 5            | ND  | ND  | 5            | ND     | ND     | 6            | ND     | ND     | 6            | 1.00   | 0.17   | 25           | ND   | ND   | 8            | ND  | ND  |

WESTBURY WATER FIRE DIST.  
SUPPLEMENTAL WATER QUALITY TABLE 2024

|                                |        |            | Well 6       |      |      | Well 9       |        |        | Well 10      |       |       | Well 11      |        |        | Well 12      |      |      |              |        |        |
|--------------------------------|--------|------------|--------------|------|------|--------------|--------|--------|--------------|-------|-------|--------------|--------|--------|--------------|------|------|--------------|--------|--------|
|                                |        |            | Raw Well     |      |      | Raw Well     |        |        | Raw Well     |       |       | Raw Well     |        |        | Raw Well     |      |      | Treated Well |        |        |
| ANALYTES                       | M.C.L. | Units      | SAMPLE COUNT | MAX  | AVG  | SAMPLE COUNT | MAX    | AVG    | SAMPLE COUNT | MAX   | AVG   | SAMPLE COUNT | MAX    | AVG    | SAMPLE COUNT | MAX  | AVG  | SAMPLE COUNT | MAX    | AVG    |
| Corrosivity                    | n/a    |            | n/a          | n/a  | n/a  | 1            | -5.01  | -5.01  | 1            | -3.63 | -3.63 | 1            | -4.14  | -4.14  | n/a          | n/a  | n/a  | n/a          | n/a    | n/a    |
| Total Dissolved Solids         | n/a    | mg/L       | n/a          | n/a  | n/a  | 1            | ND     | ND     | 1            | 89.00 | 89.00 | 1            | 28.00  | 28.00  | n/a          | n/a  | n/a  | n/a          | n/a    | n/a    |
| Turbidity                      | 5      | NTU        | n/a          | n/a  | n/a  | 1            | ND     | ND     | 1            | ND    | ND    | 1            | 1.30   | 1.30   | n/a          | n/a  | n/a  | n/a          | n/a    | n/a    |
| RADIOACTIVE CONTAMINANTS       |        |            |              |      |      |              |        |        |              |       |       |              |        |        |              |      |      |              |        |        |
| Gross Alpha                    | 15     | pCi/L      | n/a          | n/a  | n/a  | 1            | -0.65  | -0.65  | 1            | -0.35 | -0.35 | 1            | -0.26  | -0.26  | 3            | 3.64 | 2.26 | n/a          | n/a    | n/a    |
| Gross Beta                     | 50     | pCi/L      | n/a          | n/a  | n/a  | 1            | 0.53   | 0.53   | 1            | 2.65  | 2.65  | 1            | 0.51   | 0.51   | 3            | 3.29 | 2.17 | n/a          | n/a    | n/a    |
| Radium-226                     | 5      | pCi/L      | n/a          | n/a  | n/a  | 1            | 0.27   | 0.27   | 1            | 0.59  | 0.59  | 1            | 0.60   | 0.60   | 3            | 1.44 | 1.01 | n/a          | n/a    | n/a    |
| Radium-228                     | 5      | pCi/L      | n/a          | n/a  | n/a  | 1            | 0.53   | 0.53   | 1            | 0.72  | 0.72  | 1            | 0.79   | 0.79   | 3            | 1.67 | 1.44 | n/a          | n/a    | n/a    |
| Propionic Acid                 | 50     | ug/L       | 2            | ND   | ND   | n/a          | n/a    | n/a    | 2            | ND    | ND    | n/a          | n/a    | n/a    | n/a          | n/a  | n/a  | n/a          | n/a    | n/a    |
| METALS                         |        |            |              |      |      |              |        |        |              |       |       |              |        |        |              |      |      |              |        |        |
| Chromium, Hexavalent           | n/a    | ug/L       | 2            | 0.17 | 0.09 | 2            | 0.39   | 0.37   | 2            | ND    | ND    | n/a          | n/a    | n/a    | n/a          | n/a  | n/a  | n/a          | n/a    | n/a    |
| DISINFECTION BYPRODUCTS        |        |            |              |      |      |              |        |        |              |       |       |              |        |        |              |      |      |              |        |        |
| Bromodichloromethane           | 50     | ug/L       | 8            | ND   | ND   | 8            | ND     | ND     | 8            | ND    | ND    | 3            | ND     | ND     | 3            | ND   | ND   | 4            | ND     | ND     |
| Bromoform                      | 50     | ug/L       | 8            | ND   | ND   | 8            | ND     | ND     | 8            | ND    | ND    | 3            | ND     | ND     | 3            | ND   | ND   | 4            | ND     | ND     |
| Chloroform                     | 50     | ug/L       | 8            | ND   | ND   | 8            | ND     | ND     | 8            | ND    | ND    | 3            | ND     | ND     | 3            | ND   | ND   | 4            | 1.10   | 0.90   |
| Dibromoacetic Acid             | 60     | ug/L       | 2            | ND   | ND   | n/a          | n/a    | n/a    | 2            | ND    | ND    | n/a          | n/a    | n/a    | n/a          | n/a  | n/a  | n/a          | n/a    | n/a    |
| Dibromochloromethane           | 50     | ug/L       | 8            | ND   | ND   | 8            | ND     | ND     | 8            | ND    | ND    | 3            | ND     | ND     | 3            | ND   | ND   | 4            | ND     | ND     |
| Dichloroacetic Acid            | 60     | ug/L       | 2            | ND   | ND   | n/a          | n/a    | n/a    | 2            | ND    | ND    | n/a          | n/a    | n/a    | n/a          | n/a  | n/a  | n/a          | n/a    | n/a    |
| Haloacetic Acids (Total)       | 60     | ug/L       | 2            | ND   | ND   | n/a          | n/a    | n/a    | 2            | ND    | ND    | n/a          | n/a    | n/a    | n/a          | n/a  | n/a  | n/a          | n/a    | n/a    |
| Monobromoacetic Acid           | 60     | ug/L       | 2            | ND   | ND   | n/a          | n/a    | n/a    | 2            | ND    | ND    | n/a          | n/a    | n/a    | n/a          | n/a  | n/a  | n/a          | n/a    | n/a    |
| Monochloroacetic Acid          | 60     | ug/L       | 2            | ND   | ND   | n/a          | n/a    | n/a    | 2            | ND    | ND    | n/a          | n/a    | n/a    | n/a          | n/a  | n/a  | n/a          | n/a    | n/a    |
| Total Trihalomethanes (Calc.)  | 80     | ug/L       | 8            | ND   | ND   | 8            | ND     | ND     | 8            | ND    | ND    | 3            | ND     | ND     | 3            | ND   | ND   | 4            | 1.10   | 0.90   |
| Trichloroacetic Acid           | 60     | ug/L       | 2            | ND   | ND   | n/a          | n/a    | n/a    | 2            | ND    | ND    | n/a          | n/a    | n/a    | n/a          | n/a  | n/a  | n/a          | n/a    | n/a    |
| Chlorate                       | n/a    | ug/L       | 2            | ND   | ND   | 2            | ND     | ND     | 2            | ND    | ND    | n/a          | n/a    | n/a    | n/a          | n/a  | n/a  | n/a          | n/a    | n/a    |
| Bromochloroacetic Acid         | 60     | ug/L       | 2            | ND   | ND   | n/a          | n/a    | n/a    | 2            | ND    | ND    | n/a          | n/a    | n/a    | n/a          | n/a  | n/a  | n/a          | n/a    | n/a    |
| Bromodichloroacetic Acid       | 60     | ug/L       | 2            | ND   | ND   | n/a          | n/a    | n/a    | 2            | ND    | ND    | n/a          | n/a    | n/a    | n/a          | n/a  | n/a  | n/a          | n/a    | n/a    |
| Chlorodibromoacetic Acid       | 60     | ug/L       | 2            | ND   | ND   | n/a          | n/a    | n/a    | 2            | ND    | ND    | n/a          | n/a    | n/a    | n/a          | n/a  | n/a  | n/a          | n/a    | n/a    |
| Tribromoacetic Acid            | 60     | ug/L       | 2            | ND   | ND   | n/a          | n/a    | n/a    | 2            | ND    | ND    | n/a          | n/a    | n/a    | n/a          | n/a  | n/a  | n/a          | n/a    | n/a    |
| OTHER                          |        |            |              |      |      |              |        |        |              |       |       |              |        |        |              |      |      |              |        |        |
| E.coli                         | n/a    |            | 12           | ND   | ND   | 5            | ND     | ND     | 12           | ND    | ND    | 4            | ND     | ND     | 29           | ND   | ND   | 5            | ND     | ND     |
| Field pH                       | n/a    | Std. Units | n/a          | n/a  | n/a  | 1            | 5.40   | 5.40   | n/a          | n/a   | n/a   | 1            | 5.90   | 5.90   | n/a          | n/a  | n/a  | 1            | 5.10   | 5.10   |
| Field Residual Chlorine        | 1      | mg/L       | 6            | ND   | ND   | 3            | ND     | ND     | 6            | ND    | ND    | 4            | ND     | ND     | 19           | ND   | ND   | 4            | ND     | ND     |
| Field Temperature              | n/a    | deg C      | n/a          | n/a  | n/a  | 1            | 15.00  | 15.00  | n/a          | n/a   | n/a   | 1            | 17.20  | 17.20  | n/a          | n/a  | n/a  | 1            | 14.80  | 14.80  |
| LAS Molecular Weight, g/mol    | n/a    |            | n/a          | n/a  | n/a  | 1            | 320.00 | 320.00 | n/a          | n/a   | n/a   | 1            | 320.00 | 320.00 | n/a          | n/a  | n/a  | 1            | 320.00 | 320.00 |
| pH                             | n/a    | Std. Units | 1            | 4.60 | 4.60 | 1            | 4.50   | 4.50   | n/a          | n/a   | n/a   | 1            | 5.70   | 5.70   | n/a          | n/a  | n/a  | 1            | 4.70   | 4.70   |
| Tot Hardness asCaCO3 (SM 2340B | n/a    | mg/L       | n/a          | n/a  | n/a  | 1            | 13.80  | 13.80  | n/a          | n/a   | n/a   | 1            | 60.20  | 60.20  | n/a          | n/a  | n/a  | 1            | 8.30   | 8.30   |
| Total Coliforms                | n/a    |            | 12           | ND   | ND   | 5            | ND     | ND     | 12           | ND    | ND    | 4            | ND     | ND     | 29           | ND   | ND   | 5            | ND     | ND     |
| Cyanide                        | 50     | ug/L       | n/a          | n/a  | n/a  | 1            | ND     | ND     | n/a          | n/a   | n/a   | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND     | ND     |
| Specific Conductance           | n/a    | umhos/cm   | n/a          | n/a  | n/a  | 1            | 75.30  | 75.30  | n/a          | n/a   | n/a   | 1            | 257.00 | 257.00 | n/a          | n/a  | n/a  | 1            | 48.10  | 48.10  |

WESTBURY WATER FIRE DIST.  
SUPPLEMENTAL WATER QUALITY TABLE 2024

| ANALYTES                            | M.C.L. | Units | Well 15      |       |       | Well 16      |        |        | Well 9/16    |      |      | Well 17      |       |       | Well 18      |       |       |
|-------------------------------------|--------|-------|--------------|-------|-------|--------------|--------|--------|--------------|------|------|--------------|-------|-------|--------------|-------|-------|
|                                     |        |       | Raw Well     |       |       | Raw Well     |        |        | Treated Well |      |      | Raw Well     |       |       | Raw Well     |       |       |
|                                     |        |       | SAMPLE COUNT | MAX   | AVG   | SAMPLE COUNT | MAX    | AVG    | SAMPLE COUNT | MAX  | AVG  | SAMPLE COUNT | MAX   | AVG   | SAMPLE COUNT | MAX   | AVG   |
| INORGANICS                          |        |       |              |       |       |              |        |        |              |      |      |              |       |       |              |       |       |
| Antimony                            | 6      | ug/L  | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| Apparent Color                      | 15     | units | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| Arsenic                             | 10     | ug/L  | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| Barium                              | 2      | mg/L  | 1            | 0.005 | 0.005 | 1            | 0.026  | 0.026  | n/a          | n/a  | n/a  | 1            | 0.006 | 0.006 | 1            | 0.009 | 0.009 |
| Beryllium                           | 4      | ug/L  | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| Ca Hardness as CaCO3 (SM 2340B      | n/a    | mg/L  | 1            | 12.50 | 12.50 | 1            | 43.90  | 43.90  | n/a          | n/a  | n/a  | 1            | 13.60 | 13.60 | 1            | 32.70 | 32.70 |
| Cadmium                             | 5      | ug/L  | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| Chloride                            | 250    | mg/L  | 1            | 10.10 | 10.10 | 1            | 109.00 | 109.00 | n/a          | n/a  | n/a  | 1            | 10.30 | 10.30 | 1            | 46.70 | 46.70 |
| Chromium                            | 100    | mg/L  | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| Copper                              | 1.3    | mg/L  | 1            | 0.00  | 0.00  | 1            | 0.01   | 0.01   | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | 0.01  | 0.01  |
| Fluoride                            | 2.2    | mg/L  | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| Iron                                | 0.3    | mg/L  | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| Lead                                | 15     | ug/L  | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 5            | ND    | ND    |
| Manganese                           | 0.3    | mg/L  | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| MBAS, Calculated as LAS             | n/a    | mg/L  | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| Mercury                             | 2      | ug/L  | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| Nickel                              | n/a    | mg/L  | 1            | 0.00  | 0.00  | 1            | 0.00   | 0.00   | n/a          | n/a  | n/a  | 1            | 0.00  | 0.00  | 1            | 0.00  | 0.00  |
| Nitrate as N                        | 10     | mg/L  | 1            | 2.60  | 2.60  | 13           | 7.20   | 5.88   | 12           | 3.90 | 3.32 | 1            | 2.50  | 2.50  | 2            | 4.00  | 3.85  |
| Nitrate-Nitrite (as N)              | 10     | mg/L  | 1            | 2.60  | 2.60  | 13           | 7.20   | 5.88   | 12           | 3.90 | 3.33 | 1            | 2.50  | 2.50  | 2            | 4.10  | 3.90  |
| Nitrite as N                        | 1      | mg/L  | 1            | ND    | ND    | 13           | ND     | ND     | 12           | ND   | ND   | 1            | ND    | ND    | 2            | ND    | ND    |
| Nitrogen, Ammonia                   | n/a    | mg/L  | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| Odor @ 60 Degrees C                 | 3      |       | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| Selenium                            | 50     | ug/L  | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| Silver                              | 0.1    | mg/L  | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| Sodium                              | 270    | mg/L  | 1            | 7.10  | 7.10  | 1            | 35.20  | 35.20  | n/a          | n/a  | n/a  | 1            | 6.80  | 6.80  | 1            | 27.30 | 27.30 |
| Sulfate                             | 250    | mg/L  | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | 15.80 | 15.80 |
| Thallium                            | 2      | ug/L  | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| Zinc                                | 5      | mg/L  | 1            | ND    | ND    | 1            | 0.04   | 0.04   | n/a          | n/a  | n/a  | 1            | 0.03  | 0.03  | 1            | 0.05  | 0.05  |
| Calcium                             | n/a    | mg/L  | 1            | 5.00  | 5.00  | 1            | 17.60  | 17.60  | n/a          | n/a  | n/a  | 1            | 5.50  | 5.50  | 1            | 13.10 | 13.10 |
| Cyanide, Free                       | 200    | ug/L  | 1            | ND    | ND    | 1            | ND     | ND     | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| Magnesium                           | n/a    | mg/L  | 1            | 2.40  | 2.40  | 1            | 6.30   | 6.30   | n/a          | n/a  | n/a  | 1            | 2.60  | 2.60  | 1            | 5.60  | 5.60  |
| Perchlorate                         | 18     | ug/L  | 1            | ND    | ND    | 3            | 8.90   | 6.97   | n/a          | n/a  | n/a  | 1            | ND    | ND    | 1            | ND    | ND    |
| VOLATILE ORGANIC CONTAMINANTS       |        |       |              |       |       |              |        |        |              |      |      |              |       |       |              |       |       |
| 1,1,1-Trichloroethane               | 5      | ug/L  | 4            | ND    | ND    | 4            | 0.71   | 0.60   | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| 1,1,2-Trichloroethane               | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| 1,1,2-Trichlorotrifluoroethane      | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| 1,1-Dichloroethene                  | 5      | ug/L  | 4            | ND    | ND    | 4            | 2.70   | 2.38   | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| 1,2,4-Trichlorobenzene              | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| 1,2-Dichlorobenzene                 | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| 1,2-Dichloroethane                  | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| 1,2-Dichloropropane                 | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| 1,4-Dichlorobenzene                 | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| Benzene                             | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| Carbon tetrachloride                | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| Chlorobenzene                       | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| cis-1,2-Dichloroethene              | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| Ethylbenzene                        | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| Hexachloro-1,3-butadiene            | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| m&p-Xylene                          | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| Methyl-tert-butyl ether             | 10     | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| o-Xylene                            | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| Styrene                             | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| Tetrachloroethene                   | 5      | ug/L  | 4            | ND    | ND    | 4            | 1.20   | 0.93   | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| Toluene                             | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| trans-1,2-Dichloroethene            | 5      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| Trichloroethene                     | 5      | ug/L  | 4            | ND    | ND    | 4            | 1.70   | 1.50   | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| Vinyl chloride                      | 2      | ug/L  | 4            | ND    | ND    | 4            | ND     | ND     | n/a          | n/a  | n/a  | 4            | ND    | ND    | 4            | ND    | ND    |
| SYNTHETIC ORGANIC CONTAMINANTS      |        |       |              |       |       |              |        |        |              |      |      |              |       |       |              |       |       |
| 1,4-Dioxane (p-Dioxane)             | 1      | ug/L  | 5            | 0.05  | 0.03  | 12           | 1.20   | 0.95   | 12           | 0.78 | 0.58 | 5            | 0.03  | 0.02  | 5            | 0.05  | 0.04  |
| Perfluorooctanoic Acid (PFOA)       | 10     | ng/l  | 5            | ND    | ND    | 12           | 14.70  | 9.18   | 12           | 8.96 | 6.38 | 4            | ND    | ND    | 6            | 10.40 | 7.41  |
| Perfluorooctanesulfonic Acid (PFOS) | 10     | ng/l  | 5            | ND    | ND    | 12           | ND     | ND     | 12           | ND   | ND   | 4            | ND    | ND    | 6            | 5.21  | 3.65  |

WESTBURY WATER FIRE DIST.  
SUPPLEMENTAL WATER QUALITY TABLE 2024

|                                                                                   |        |       | Well 15      |     |     | Well 16      |     |     | Well 9/16    |     |     | Well 17      |     |     | Well 18      |      |      |
|-----------------------------------------------------------------------------------|--------|-------|--------------|-----|-----|--------------|-----|-----|--------------|-----|-----|--------------|-----|-----|--------------|------|------|
|                                                                                   |        |       | Raw Well     |     |     | Raw Well     |     |     | Treated Well |     |     | Raw Well     |     |     | Raw Well     |      |      |
| ANALYTES                                                                          | M.C.L. | Units | SAMPLE COUNT | MAX | AVG | SAMPLE COUNT | MAX | AVG | SAMPLE COUNT | MAX | AVG | SAMPLE COUNT | MAX | AVG | SAMPLE COUNT | MAX  | AVG  |
| 2,4,5-TP (Silvex)                                                                 | 10     | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 8            | ND   | ND   |
| 2,4-D                                                                             | 50     | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 8            | 0.14 | 0.02 |
| Dalapon                                                                           | 50     | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 8            | ND   | ND   |
| Dicamba                                                                           | 50     | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 8            | ND   | ND   |
| Dinoseb                                                                           | 7      | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 8            | ND   | ND   |
| Pentachlorophenol                                                                 | 1      | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 8            | ND   | ND   |
| Picloram                                                                          | 50     | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 8            | ND   | ND   |
| Atrazine                                                                          | 3      | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 5            | ND   | ND   |
| Metolachlor                                                                       | 50     | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | ND   |
| Metribuzin                                                                        | 50     | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | ND   |
| Propachlor                                                                        | 50     | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | ND   |
| Simazine                                                                          | 4      | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 5            | ND   | ND   |
| Hexachlorocyclopentadiene                                                         | 5      | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 5            | ND   | ND   |
| 3-Hydroxycarbofuran                                                               | 50     | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | ND   |
| Aldicarb                                                                          | 3      | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | ND   |
| Aldicarb sulfone                                                                  | 2      | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | ND   |
| Aldicarb sulfoxide                                                                | 4      | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | ND   |
| Carbofuran                                                                        | 40     | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | ND   |
| Methomyl                                                                          | 50     | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | ND   |
| Oxamyl                                                                            | 200    | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | ND   |
| Glyphosate                                                                        | 50     | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | 2.98 |
| Endothall                                                                         | 50     | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | ND   |
| Diquat                                                                            | 20     | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | ND   |
| Alachlor                                                                          | 2      | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 5            | ND   | ND   |
| Chlordane (Technical)                                                             | 2      | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | ND   |
| Endrin                                                                            | 2      | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 5            | ND   | ND   |
| gamma-BHC (Lindane)                                                               | 0.2    | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 5            | ND   | ND   |
| Heptachlor                                                                        | 400    | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 5            | ND   | ND   |
| Heptachlor epoxide                                                                | 200    | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 5            | ND   | ND   |
| Benzo(a)pyrene                                                                    | 200    | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 5            | ND   | ND   |
| bis(2-Ethylhexyl)adipate                                                          | 400    | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 5            | ND   | ND   |
| bis(2-Ethylhexyl)phthalate                                                        | 6      | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 5            | ND   | ND   |
| Hexachlorobenzene                                                                 | 1      | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 5            | ND   | ND   |
| Methoxychlor                                                                      | 40     | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 5            | ND   | ND   |
| PCB Screen                                                                        | 0.5    | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | ND   |
| Toxaphene                                                                         | 3      | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | ND   |
| 1,2-Dibromo-3-chloropropane                                                       | 200    | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | ND   |
| 1,2-Dibromoethane (EDB)                                                           | 50     | ug/L  | 1            | ND  | ND  | 1            | ND  | ND  | n/a          | n/a | n/a | 1            | ND  | ND  | 4            | ND   | ND   |
| UCMR5                                                                             |        |       |              |     |     |              |     |     |              |     |     |              |     |     |              |      |      |
| Perfluorobutanesulfonic Acid (PFBS)                                               | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | ND   | ND   |
| Perfluoroheptanoic Acid (PFHpA)                                                   | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | 4.35 | 2.98 |
| Perfluorohexanesulfonic Acid (PFHxS)                                              | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | 1.83 | 0.31 |
| Perfluorononanoic Acid (PFNA)                                                     | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | 2.82 | 0.90 |
| 4,8-Dioxa-3h-Perfluorononanoic Acid (ADONA)                                       | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | ND   | ND   |
| Perfluoro(2-Ethoxyethane)Sulfonic Acid (PFEESA)                                   | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | ND   | ND   |
| Nonafluoro-3,6-Dioxaheptanoic Acid (NFDHA)                                        | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | ND   | ND   |
| Perfluorobutanoic Acid (PFBA)                                                     | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | 4.97 | 3.49 |
| Perfluorodecanoic Acid (PFDA)                                                     | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | ND   | ND   |
| Perfluorododecanoic Acid (PFDoA)                                                  | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | ND   | ND   |
| Perfluoroheptanesulfonic Acid (PFHpS)                                             | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | ND   | ND   |
| Perfluorohexanoic Acid (PFHxA)                                                    | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | 6.18 | 4.11 |
| Perfluoropentanesulfonic Acid (PFPeS)                                             | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | ND   | ND   |
| Perfluoropentanoic Acid (PFPeA)                                                   | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | 6.63 | 4.26 |
| Perfluoroundecanoic Acid (PFUnA)                                                  | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | ND   | ND   |
| Perfluoro-3-Methoxypropanoic Acid (PFMPA)                                         | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | ND   | ND   |
| Perfluoro-4-Methoxybutanoic Acid (PFMBA)                                          | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | ND   | ND   |
| 1H,1H,2H,2H-Perfluorohexanesulfonic Acid (4:2FTS)                                 | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | ND   | ND   |
| 1H,1H,2H,2H-Perfluorooctanesulfonic Acid (6:2FTS)                                 | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | ND   | ND   |
| 9-Chlorohexadecafluoro-3-Oxanone-1-Sulfonic Acid (9CI-PF3ONS)                     | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | ND   | ND   |
| 1H,1H,2H,2H-Perfluorodecanesulfonic Acid (8:2FTS)                                 | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | ND   | ND   |
| 11-Chloroeicosafluoro-3-Oxaundecane-1-Sulfonic Acid (11CI-PF3OUdS)                | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | ND   | ND   |
| 2,3,3,3-Tetrafluoro-2-[1,1,2,2,3,3,3-Heptafluoropropoxy]-Propanoic Acid (HFPO-DA) | 50,000 | ng/l  | 5            | ND  | ND  | 12           | ND  | ND  | 12           | ND  | ND  | 4            | ND  | ND  | 6            | ND   | ND   |

WESTBURY WATER FIRE DIST.  
SUPPLEMENTAL WATER QUALITY TABLE 2024

| ANALYTES                             | M.C.L. | Units      | Well 15         |        |        | Well 16         |        |        | Well 9/16       |      |      | Well 17         |        |        | Well 18         |        |        |
|--------------------------------------|--------|------------|-----------------|--------|--------|-----------------|--------|--------|-----------------|------|------|-----------------|--------|--------|-----------------|--------|--------|
|                                      |        |            | Raw Well        |        |        | Raw Well        |        |        | Treated Well    |      |      | Raw Well        |        |        | Raw Well        |        |        |
|                                      |        |            | SAMPLE<br>COUNT | MAX    | AVG    | SAMPLE<br>COUNT | MAX    | AVG    | SAMPLE<br>COUNT | MAX  | AVG  | SAMPLE<br>COUNT | MAX    | AVG    | SAMPLE<br>COUNT | MAX    | AVG    |
| OTHER PRINCIPAL ORGANIC CONTAMINANTS |        |            |                 |        |        |                 |        |        |                 |      |      |                 |        |        |                 |        |        |
| 1,1,1,2-Tetrachloroethane            | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| 1,1,2,2-Tetrachloroethane            | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| 1,1-Dichloroethane                   | 5      | ug/L       | 4               | ND     | ND     | 4               | 1.90   | 1.47   | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| 1,1-Dichloropropene                  | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| 1,2,3-Trichlorobenzene               | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| 1,2,3-Trichloropropane               | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| 1,2,4-Trimethylbenzene               | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| 1,3,5-Trimethylbenzene               | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| 1,3-Dichlorobenzene                  | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| 1,3-Dichloropropane                  | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| 2,2-Dichloropropane                  | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| 2-Chlorotoluene                      | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| 4-Chlorotoluene                      | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| Bromobenzene                         | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| Bromochloromethane                   | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| Bromomethane                         | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| Chlorodifluoromethane                | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| Chloroethane                         | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| Chloromethane                        | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| cis-1,3-Dichloropropene              | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| Dibromomethane                       | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| Dichlorodifluoromethane              | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| Isopropylbenzene (Cumene)            | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| Methylene Chloride                   | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| n-Butylbenzene                       | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| n-Propylbenzene                      | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| p-Isopropyltoluene                   | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| sec-Butylbenzene                     | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| tert-Butylbenzene                    | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| trans-1,3-Dichloropropene            | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| Trichlorofluoromethane               | 5      | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| Aldrin                               | 5      | ug/L       | 1               | ND     | ND     | 1               | ND     | ND     | n/a             | n/a  | n/a  | 1               | ND     | ND     | 4               | ND     | ND     |
| Dieldrin                             | 2      | ug/L       | 1               | ND     | ND     | 1               | ND     | ND     | n/a             | n/a  | n/a  | 1               | ND     | ND     | 4               | ND     | ND     |
| UNSPECIFIED ORGANIC CONTAMINANTS     |        |            |                 |        |        |                 |        |        |                 |      |      |                 |        |        |                 |        |        |
| Butachlor                            | 50     | ug/L       | 1               | ND     | ND     | 1               | ND     | ND     | n/a             | n/a  | n/a  | 1               | ND     | ND     | 4               | ND     | ND     |
| Carbaryl                             | 50     | ug/L       | 1               | ND     | ND     | 1               | ND     | ND     | n/a             | n/a  | n/a  | 1               | ND     | ND     | 4               | ND     | ND     |
| DISINFECTION BYPRODUCTS              |        |            |                 |        |        |                 |        |        |                 |      |      |                 |        |        |                 |        |        |
| Bromodichloromethane                 | 50     | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | 0.56   | 0.14   |
| Bromoform                            | 50     | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| Chloroform                           | 50     | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | ND     | ND     |
| Dibromochloromethane                 | 50     | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | 0.69   | 0.17   |
| Total Trihalomethanes (Calc.)        | 80     | ug/L       | 4               | ND     | ND     | 4               | ND     | ND     | n/a             | n/a  | n/a  | 4               | ND     | ND     | 4               | 1.20   | 0.30   |
| OTHER                                |        |            |                 |        |        |                 |        |        |                 |      |      |                 |        |        |                 |        |        |
| Alkalinity, Total as CaCO3           | n/a    | mg/L       | 1               | 9.70   | 9.70   | 1               | 8.00   | 8.00   | n/a             | n/a  | n/a  | 1               | 9.20   | 9.20   | 1               | 21.50  | 21.50  |
| E.coli                               | n/a    |            | 4               | ND     | ND     | 5               | ND     | ND     | 11              | ND   | ND   | 4               | ND     | ND     | 4               | ND     | ND     |
| Field pH                             | n/a    | Std. Units | 1               | 6.00   | 6.00   | 1               | 5.70   | 5.70   | n/a             | n/a  | n/a  | 1               | 6.00   | 6.00   | 1               | 6.10   | 6.10   |
| Field Residual Chlorine              | 1      | mg/L       | n/a             | n/a    | n/a    | n/a             | n/a    | n/a    | 10              | 1.20 | 0.89 | n/a             | n/a    | n/a    | n/a             | n/a    | n/a    |
| Field Temperature                    | n/a    | deg C      | 1               | 14.20  | 14.20  | 1               | 14.20  | 14.20  | n/a             | n/a  | n/a  | 1               | 14.00  | 14.00  | 1               | 15.20  | 15.20  |
| LAS Molecular Weight, g/mol          | n/a    |            | 1               | 320.00 | 320.00 | 1               | 320.00 | 320.00 | n/a             | n/a  | n/a  | 1               | 320.00 | 320.00 | 1               | 320.00 | 320.00 |
| pH                                   | n/a    | Std. Units | 1               | 5.80   | 5.80   | 1               | 5.70   | 5.70   | n/a             | n/a  | n/a  | 1               | 5.80   | 5.80   | 1               | 5.90   | 5.90   |
| Tot Hardness asCaCO3 (SM 2340B       | n/a    | mg/L       | 1               | 22.20  | 22.20  | 1               | 70.00  | 70.00  | n/a             | n/a  | n/a  | 1               | 24.20  | 24.20  | 1               | 55.80  | 55.80  |
| Total Coliforms                      | n/a    |            | 4               | ND     | ND     | 5               | ND     | ND     | 11              | ND   | ND   | 4               | ND     | ND     | 4               | ND     | ND     |

WESTBURY WATER FIRE DIST.  
SUPPLEMENTAL WATER QUALITY TABLE 2024

|                                |        |            | Well 15      |       |       | Well 16      |        |        | Well 9/16    |        |        | Well 17      |       |       | Well 18      |        |        |
|--------------------------------|--------|------------|--------------|-------|-------|--------------|--------|--------|--------------|--------|--------|--------------|-------|-------|--------------|--------|--------|
|                                |        |            | Raw Well     |       |       | Raw Well     |        |        | Treated Well |        |        | Raw Well     |       |       | Raw Well     |        |        |
| ANALYTES                       | M.C.L. | Units      | SAMPLE COUNT | MAX   | AVG   | SAMPLE COUNT | MAX    | AVG    | SAMPLE COUNT | MAX    | AVG    | SAMPLE COUNT | MAX   | AVG   | SAMPLE COUNT | MAX    | AVG    |
| Corrosivity                    | n/a    |            | 1            | -3.91 | -3.91 | 1            | -3.80  | -3.80  | n/a          | n/a    | n/a    | 1            | -3.91 | -3.91 | 1            | -3.05  | -3.05  |
| Total Dissolved Solids         | n/a    | mg/L       | 1            | 40.00 | 40.00 | 1            | 217.00 | 217.00 | n/a          | n/a    | n/a    | 1            | 42.00 | 42.00 | 1            | 138.00 | 138.00 |
| Turbidity                      | 5      | NTU        | 1            | 1.10  | 1.10  | 1            | ND     | ND     | n/a          | n/a    | n/a    | 1            | ND    | ND    | 1            | 1.00   | 1.00   |
| RADIOACTIVE CONTAMINANTS       |        |            |              |       |       |              |        |        |              |        |        |              |       |       |              |        |        |
| Gross Alpha                    | 15     | pCi/L      | 1            | 0.16  | 0.16  | 1            | 2.58   | 2.58   | n/a          | n/a    | n/a    | 1            | 0.37  | 0.37  | 1            | -0.71  | -0.71  |
| Gross Beta                     | 50     | pCi/L      | 1            | 2.03  | 2.03  | 1            | 3.75   | 3.75   | n/a          | n/a    | n/a    | 1            | -0.03 | -0.03 | 1            | 2.51   | 2.51   |
| Radium-226                     | 5      | pCi/L      | 1            | 0.10  | 0.10  | 1            | 2.26   | 2.26   | n/a          | n/a    | n/a    | 1            | -0.02 | -0.02 | 1            | 0.06   | 0.06   |
| Radium-228                     | 5      | pCi/L      | 1            | 0.68  | 0.68  | 1            | 2.87   | 2.87   | n/a          | n/a    | n/a    | 1            | 0.87  | 0.87  | 1            | 1.18   | 1.18   |
| Propionic Acid                 | 50     | ug/L       | n/a          | n/a   | n/a   | n/a          | n/a    | n/a    | n/a          | n/a    | n/a    | 2            | ND    | ND    | n/a          | n/a    | n/a    |
| METALS                         |        |            |              |       |       |              |        |        |              |        |        |              |       |       |              |        |        |
| Chromium, Hexavalent           | n/a    | ug/L       | n/a          | n/a   | n/a   | n/a          | n/a    | n/a    | 1            | 2.20   | 2.20   | 1            | 0.64  | 0.64  | n/a          | n/a    | n/a    |
| DISINFECTION BYPRODUCTS        |        |            |              |       |       |              |        |        |              |        |        |              |       |       |              |        |        |
| Bromodichloromethane           | 50     | ug/L       | 4            | ND    | ND    | 4            | ND     | ND     | 4            | ND     | ND     | 4            | ND    | ND    | 4            | ND     | ND     |
| Bromoform                      | 50     | ug/L       | 4            | ND    | ND    | 4            | ND     | ND     | 4            | ND     | ND     | 4            | ND    | ND    | 4            | ND     | ND     |
| Chloroform                     | 50     | ug/L       | 4            | 0.99  | 0.87  | 4            | ND     | ND     | 4            | 0.79   | 0.73   | 4            | ND    | ND    | 4            | 0.81   | 0.55   |
| Dibromoacetic Acid             | 60     | ug/L       | n/a          | n/a   | n/a   | n/a          | n/a    | n/a    | n/a          | n/a    | n/a    | 1            | ND    | ND    | n/a          | n/a    | n/a    |
| Dibromochloromethane           | 50     | ug/L       | 4            | ND    | ND    | 4            | ND     | ND     | 4            | ND     | ND     | 4            | ND    | ND    | 4            | ND     | ND     |
| Dichloroacetic Acid            | 60     | ug/L       | n/a          | n/a   | n/a   | n/a          | n/a    | n/a    | n/a          | n/a    | n/a    | 1            | ND    | ND    | n/a          | n/a    | n/a    |
| Haloacetic Acids (Total)       | 60     | ug/L       | n/a          | n/a   | n/a   | n/a          | n/a    | n/a    | n/a          | n/a    | n/a    | 1            | ND    | ND    | n/a          | n/a    | n/a    |
| Monobromoacetic Acid           | 60     | ug/L       | n/a          | n/a   | n/a   | n/a          | n/a    | n/a    | n/a          | n/a    | n/a    | 1            | ND    | ND    | n/a          | n/a    | n/a    |
| Monochloroacetic Acid          | 60     | ug/L       | n/a          | n/a   | n/a   | n/a          | n/a    | n/a    | n/a          | n/a    | n/a    | 1            | ND    | ND    | n/a          | n/a    | n/a    |
| Total Trihalomethanes (Calc.)  | 80     | ug/L       | 4            | 0.99  | 0.87  | 4            | ND     | ND     | 4            | 0.79   | 0.73   | 4            | ND    | ND    | 4            | 0.81   | 0.55   |
| Trichloroacetic Acid           | 60     | ug/L       | n/a          | n/a   | n/a   | n/a          | n/a    | n/a    | n/a          | n/a    | n/a    | 1            | ND    | ND    | n/a          | n/a    | n/a    |
| Chlorate                       | n/a    | ug/L       | n/a          | n/a   | n/a   | n/a          | n/a    | n/a    | 1            | 29.40  | 29.40  | 1            | 21.70 | 21.70 | n/a          | n/a    | n/a    |
| Bromochloroacetic Acid         | 60     | ug/L       | n/a          | n/a   | n/a   | n/a          | n/a    | n/a    | n/a          | n/a    | n/a    | 1            | ND    | ND    | n/a          | n/a    | n/a    |
| Bromodichloroacetic Acid       | 60     | ug/L       | n/a          | n/a   | n/a   | n/a          | n/a    | n/a    | n/a          | n/a    | n/a    | 1            | ND    | ND    | n/a          | n/a    | n/a    |
| Chlorodibromoacetic Acid       | 60     | ug/L       | n/a          | n/a   | n/a   | n/a          | n/a    | n/a    | n/a          | n/a    | n/a    | 1            | ND    | ND    | n/a          | n/a    | n/a    |
| Tribromoacetic Acid            | 60     | ug/L       | n/a          | n/a   | n/a   | n/a          | n/a    | n/a    | n/a          | n/a    | n/a    | 1            | ND    | ND    | n/a          | n/a    | n/a    |
| OTHER                          |        |            |              |       |       |              |        |        |              |        |        |              |       |       |              |        |        |
| E.coli                         | n/a    |            | 12           | ND    | ND    | 5            | ND     | ND     | 8            | ND     | ND     | 16           | ND    | ND    | 5            | ND     | ND     |
| Field pH                       | n/a    | Std. Units | n/a          | n/a   | n/a   | 1            | 5.20   | 5.20   | 1            | 6.10   | 6.10   | n/a          | n/a   | n/a   | 1            | 5.60   | 5.60   |
| Field Residual Chlorine        | 1      | mg/L       | 9            | ND    | ND    | 4            | ND     | ND     | 7            | ND     | ND     | 13           | ND    | ND    | 3            | ND     | ND     |
| Field Temperature              | n/a    | deg C      | n/a          | n/a   | n/a   | 1            | 15.60  | 15.60  | 1            | 16.40  | 16.40  | n/a          | n/a   | n/a   | 1            | 14.60  | 14.60  |
| LAS Molecular Weight, g/mol    | n/a    |            | n/a          | n/a   | n/a   | 1            | 320.00 | 320.00 | 1            | 320.00 | 320.00 | n/a          | n/a   | n/a   | 1            | 320.00 | 320.00 |
| pH                             | n/a    | Std. Units | n/a          | n/a   | n/a   | 1            | 5.50   | 5.50   | 1            | 5.70   | 5.70   | n/a          | n/a   | n/a   | 1            | 5.10   | 5.10   |
| Tot Hardness asCaCO3 (SM 2340B | n/a    | mg/L       | n/a          | n/a   | n/a   | 1            | 3.20   | 3.20   | 1            | 43.10  | 43.10  | n/a          | n/a   | n/a   | 1            | 7.80   | 7.80   |
| Total Coliforms                | n/a    |            | 12           | ND    | ND    | 5            | ND     | ND     | 8            | ND     | ND     | 16           | ND    | ND    | 5            | ND     | ND     |
| Cyanide                        | 50     | ug/L       | n/a          | n/a   | n/a   | 1            | ND     | ND     | 1            | ND     | ND     | n/a          | n/a   | n/a   | 1            | ND     | ND     |
| Specific Conductance           | n/a    | umhos/cm   | n/a          | n/a   | n/a   | 1            | 27.80  | 27.80  | 1            | 156.00 | 156.00 | n/a          | n/a   | n/a   | 1            | 47.60  | 47.60  |